Honeywell
THE POWER OF CONNECTED

Farenhyt™ Series

System Record Documents (SRD) Cabinet

Fire System Record Documents Cabinent

Description

The Farenhyt System Record Documents (SRD) Cabinet is the perfect solution to comply with the demanding code standards required today. Farenhyt's primary goal is to manufacture code compliant solutions and this product allows you to do just that. The SRD cabinet is the answer to comply with the NFPA 72 2013, Section 7.7.2.1 requirements which states, "With every new system, a documentation cabinet shall be installed at the system control unit or other approved location at the protected premises."

This cabinet is constructed of durable 16 gauge steel with a solid piano hinge and key lock. The cabinet includes a 4GB USB memory flash drive interface. Using a standard USB B connector, the USB flash drive interface allows you to use any standard USB printer cable to upload or download information. This feature allows you to store your records electronically in one secure place, so that the Technician can easily access the software and service the system. (Refer to NFPA, 72 2013, Section 7.5.6.7).

Along with the fire alarm control panel software, you can store your test and inspection documents, service records, manuals & AS built drawings for the system.

The System Records Document (SRD) cabinet inner door has two, key ring hooks to hold system keys. In the inner door, you can add the Legend Sheet to record property, system, service, code and AHJ certification information, as well as required documentation. (See Figure 2).



Fire Alarm Documents Cabinet

Ordering Information:

SKF-SRD: System Record Documents Cabinet, Red. Includes Farenhyt lock.

FEATURES & BENEFITS

- Installed with a 4 gigabyte digital flash drive interface with USB B connector
- Overall Dimensions 12"Width x 13" Height x 2 ¼" Depth (30.48 W x 33.02 H x 5.71 D cm)
- Offers two, key ring hooks to hold the system keys
- Contains a frame plate to insert Authorized Personnel business cards
- Includes a Legend Sheet to record passwords and system information
- Constructed with 16 gauge steel box and cover for added security with a solid stainless steel piano hinge
- Coated with a durable baked-on enamel finish (other colors available)
- Built with a stainless steel piano hinge with standard ¾" CAT 30 keyed door lock (other lock assemblies available)
- Imprinted with white indelible ink, 1" high lettering labeled, "SYSTEM RECORD DOCUMENTS"

Figure 1 shows the interior enclosure of the Fire Alarm Documents cabinet

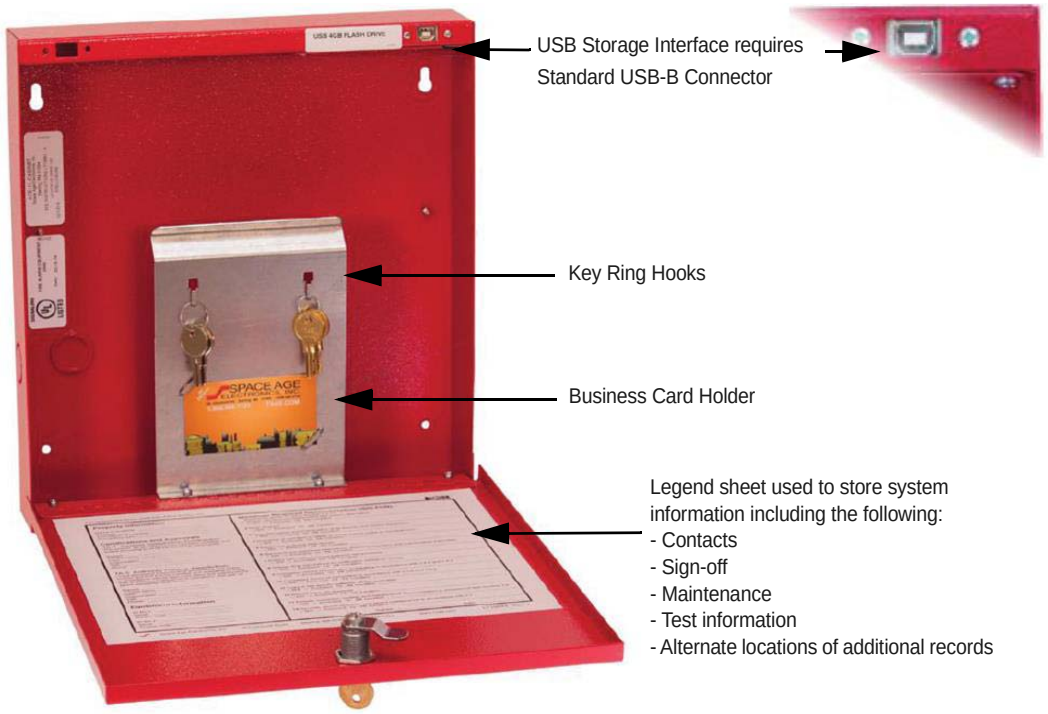


Figure 1 Fire Alarm Documents Cabinet

Figure 2 shows the Legend Sheet attached to the inner door of the Fire Alarm Documents cabinet

Property Information	**Minimum Required Documentation**
Name of Property:_____	1 Written narrative providing intent and system description.
Address:_____	☐ N/A ☐ Enclosed or Alt. Location:_____
Description of Property: _____	2 Riser diagram
Occupancy Type:_____	☐ N/A ☐ Enclosed or Alt. Location:_____
Certification and Approvals	3 Floor plan layout showing location of all devices and control equipment.
16.1 System Installation Contractor:	☐ **N/A** ☐ Enclosed or Alt. Location:_____
This system, as specified herein, has been installed and tested according to all NFPA Standards cited therein.	4 Sequence of operation in either an input/ output matrix or narrative form.
	☐ N/A ☐ Enclosed or Alt. Location:_____
Signed:_____	5 Equipment technical data sheets.
Printed Name:_____	☐ N/A ☐ Enclosed or Alt. Location:_____
Date: _____/_____/_____	6 Manufacturers published instructions, including operation and maintenance instruction.
Organization:_____	☐ N/A ☐ Enclosed or Alt. Location:_____
Title:_____	7 Battery calculations (where batteries are provided).
Phone:_____	☐ N/A ☐ Enclosed or Alt. Location:_____
16.5 Authority Having Jurisdiction:	8 Voltage drop calculations for notification appliance circuits.
I have witnessed a satisfactory acceptance test of this with system and find it to be installed and operating properly in accordance with its approved plans and specifications, its approved sequence of operations, and with all NFPA standards cited herein.	☐ N/A ☐ Enclosed or Alt. Location:_____
	9 Completed record of inspection and testing in accordance with 7.6.6 and 7.8.2.
	☐ N/A ☐ Enclosed or Alt. Location:_____
	10 Completed record of completion in accordance with 7.5.6 and 7.8.2.
	☐ N/A ☐ Enclosed or Alt. Location:_____
Signed:_____	11 Copy of site specific software, where applicable.
Printed Name:_____	☐ N/A ☐ Enclosed or Alt. Location:_____
Date: _____/_____/_____	12 Record (as-built) drawings.
Organization:_____	☐ N/A ☐ Enclosed or Alt. Location:_____
Title:_____	13 Periodic inspection, testing, and maintenance documentation in accordance with Section 7.6.
Phone:_____	☐ N/A ☐ Enclosed or Alt. Location:_____
Equipment Information:_____	14 Records, record retention, and record maintenance in accordance with 7.7.
ID No. 1:_____	☐ N/A ☐ Enclosed or Alt. Location:_____
Serial: _____	
Access Code: _____	
ID No. 2:_____	
Serial: _____	
Access Code: _____	Signed:_____ Date:_____/_____/_____

Figure 2 Legend Sheet

System Record Documents (SRD) Cabinet Technical Specifications

SYSTEMS

SRD: System Record Documents Cabinet

Dimensions: 12" W x 13" H x 2 1/4" D (30.48 W x 33.02 H x 5.71 D cm)

Door Keylock: Barrel lock and piano hinge

Dimensions: 3/4" barrel lock and 12" (30.48 cm) piano hinge

FAD Cabinet: UL® Listed, constructed of 18 gauge cold rolled steel

Cabinet Finish: Red powder coat epoxy finish

Cabinet Cover Label: Silkscreen imprinted with white indelible ink, 1" high lettering labeled, "SYSTEM RECORD DOCUMENTS"

Cabinet Keylock: Keylocked with 3/4" barrel lock and 12" (30.48 cm) width stainless steel piano hinge

Cabinet Backbox: The backbox includes a 4-hole knockout mounting pattern.

Cabinet Frame Plate: insert frame plate accommodates and protects standard 8 1/2 x 11 manuals and document records.

Cabinet Inner Door Label: Legend Sheet attached to the inner door frame for system required documentation, key contacts and code information.

Cabinet Flash Drive Interface: 4 Gigabyte (minimum) digital flash memory drive with a standard USB B connector (used to upload and download information) is securely assembled to the interior cabinet.

The drive is restricted to Authorized personnel with permission to use secure hardware devices to access the records.

Cabinet Key Holder: Two key ring holders and a pre-assembled frame plate to insert Authorized Personnel business cards.

STANDARDS

The System Record Documents (SRD) Cabinet is designed to comply with the following standard:

UL Standard: S2580

AGENCY LISTINGS AND APPROVALS

These listings and approvals apply to the modules specified in this document. In some cases, certain modules or applications may not be listed by certain approval agencies, or listing may be in process. Consult factory for latest listing status.

UL: S2580, Vol. 3

CSFM: 7300-0553-0110

NFPA: 72 2013

NEMA

ISO 9001 Certification

For a complete listing of all compliance approvals and certifications, please visit http://www.silentknight.com/documentation/Pages/default.aspx

Farenhyt® is a registered trademark of Honeywell International Inc.
SpaceAgeElectronics, Inc. is a © copyright.
UL® is a registered trademark of Underwriter's Laboratories, Inc.
©2018. All rights reserved. Unauthorized use of this document is strictly prohibited.

This document is not intended to be used for installation purposes. We try to keep our product information up-to-date and accurate. We cannot cover all specific applications or anticipate all requirements. All specifications are subject to change without notice.

For more information

Learn more about Honeywell's System Record Documents (SRD) Cabinet and other products available by visiting www.farenhyt.com.

Honeywell Security & Fire
12 Clintonville Road
Northford, CT 06472-1610
203.484.7161
www.farenhyt.com

FH-61034 | A | 5/18
©2018 Honeywell International Inc.

Honeywell