

INSTALLATION AND MAINTENANCE INSTRUCTIONS

SYNC-1A Accessory Card

Compatible Devices:

Notification Appliances: H12/24, H12/24K, HC12/24, S12XX, S24XX, SC24XX, P12XX, P24XX, PC24XX, SP2C24XX, SP2424XX, SP2W24XX, DS2475XXX, S1224MC, S1224MCW, SP2R1224MC, SP2W1224MC, P1224MC-Series, P1224MCW, S1224MC-Series, CH24MC, CH24MCW, SP3R1224MC, SP3R1224MCW, SP2R1224MCK, P2RX, P2WX, P4RX, P4WX, SRX, SWX, SCRX, SCWX, HRX, HWX, CHX, CHRX, CHWX, CHSRX, CHSWX, PC2RX, PC2WX, PC4RX, PC4WX, H12/24X, PA400X, S1224MCX, SC24XX, SP2R1224MCX, SP2W1224MCX, CH24MCX, MHR(A), MHW(A), MHRZA, MHWZA, SPSX, SPSCX, B200S, B200SR

Add suffix "W" for white models

Control Modules: Used with a ULC listed Six Supervised Control Module.

Control Panels: Refer to six supervised control module installation manual for list.

Power Supplies: Use any regulated power supply that is UL listed. Any UL listed power supply may also be used, but it must be intended for use with NAC devices.

SPECIFICATIONS

Standby Current (+ 0 position):	15mA
Standby Current (+ 2 or + 4 position, if connected to supply):	2.5mA
Operating Temperature:	32°F to 120°F (0°C to 49°C)
Wire Gauge:	12-18 AWG
Included:	(2) shunts, (4) screws, (2) standoffs
Maximum Loop Power Supply Current Rating (Class A / Style Z):	2A (See NOTE 1)
Maximum Loop Power Supply Current Rating (Class B / Style Y):	3A per pair (See NOTE 1)
Power Supply Voltage Range:	Refer to compatible power supply installation manual
Maximum Load on a Loop (Class A / Style Z):	(See NOTE 1)
Maximum Load on a Loop (Class B / Style Y):	(See NOTE 1)
(maximum alarm current = maximum load on a loop, both cases)	

NOTE 1: Refer to installation manual to determine the number of compatible notification appliances, their voltage requirements, current requirements, and wire size. The sum of the inrush currents, of all the notification appliances connected to a loop, must be equal or less than the Loop Power Supply Current Rating.

GENERAL DESCRIPTION

The SYNC-1A Accessory Card is designed to operate with the Six Supervised Control Module. It works with the SpectrAlert series of horns, strobes, and horn/strobes to provide a means of synchronizing the temporal-coded horns, synchronizing the one-second flash timing of the strobe, and silencing the horns of the horn/strobe combination over a two-wire circuit while leaving the strobes active. Each SYNC-1A Accessory Card consists of three electrically isolated synchronization circuits. Although they are isolated from each other, all three circuits are synchronized with respect to each other. A SYNC-1A Accessory Card enables a Six Supervised Control Module to synchronize a maximum of three Class A or six Class B notification appliance circuits (NACs).

NOTE: This manual should be left with the owner/user of this equipment.

TEMPORAL CODING ON MA12/24D AND PA400 (NON-SPECTRALERT HORNS)

- Program module to provide temporal coding by inserting jumper on "temporal" pins on the SYNC-1A board. Do this prior to installing the SYNC-1A Accessory Card onto the Six Supervised Control Module.
- Connect only sounders producing a continuous tone to the module NAC output(s).




Strobes are incapable of operation on a temporal tone Notification Appliance Circuit.



6581 Kitimat Road, Unit 6
Mississauga, Ontario L5N-3T5
PH: 1-800-SENSOR2 Fax: 1-800-812-0771

FIGURE 1: INSTALLATION OF SYNC-1A

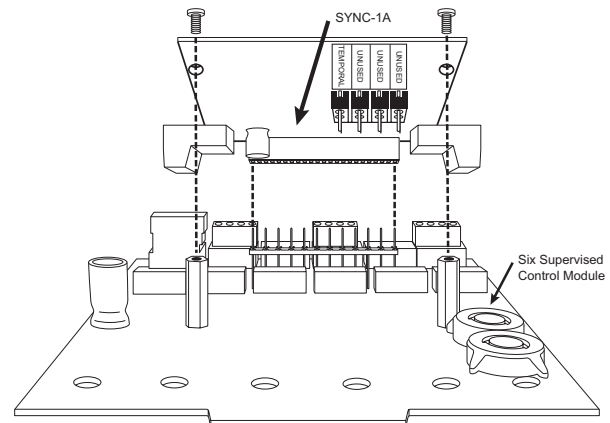


C0126-00

INSTALLATION OF SYNC-1A ACCESSORY CARD

Install two screws into the holes on the bottom center of the Six Supervised Control Module. On the front side of the board, install two standoffs into these screws. The SYNC-1A Accessory Card plugs into the pins of the Six Supervised Control Module. The pins on the module are labeled "SYNC GENERATOR." Remove the three large shunts on the Sync Generator pins. Line up the holes on the accessory card with the pins on Six Supervised Control Module.

CAUTION: Ensure the pins and holes are lined up correctly or the SYNC-1A Accessory card will not operate properly. Push down firmly on the accessory card. Install two screws into standoffs to secure the board.

FIGURE 2: CONNECTING TWO SYNC-1A CARDS (CLASS B OPERATION, ONE POWER SUPPLY USED)

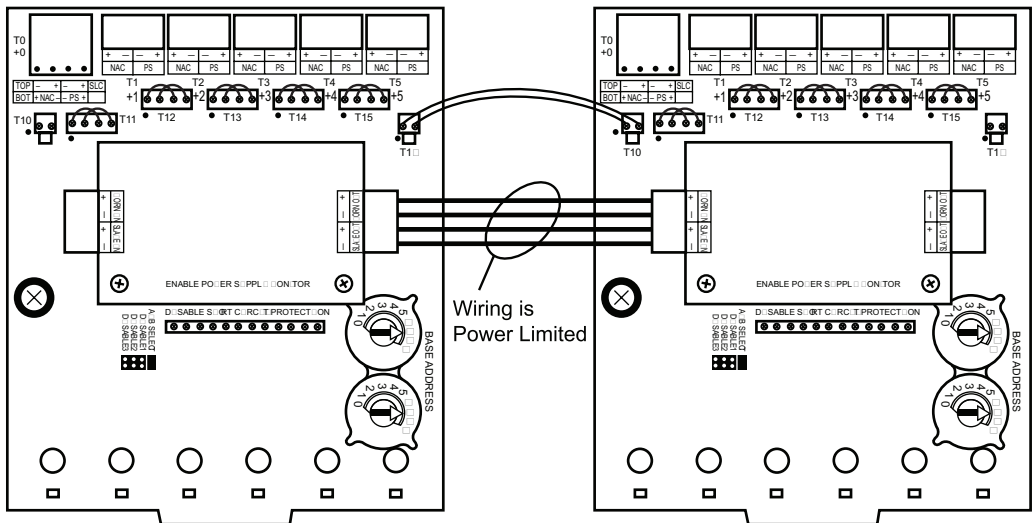

C0123-01

WIRING

When used with the SYNC-1A Accessory Card, the Six Supervised Control Module can accommodate a maximum of three power supplies limited to a maximum of 3 Amp each. The SYNC-1A Accessory Card control circuitry can only be energized by connecting power supplies to the “PS” terminals at the even positions (+0, +2, +4) of the Six Supervised Control Module. All power supply connections must be made at even positions. The master control of the SYNC-1A Accessory Card is powered by the supply connected to the “PS” terminals at position (+0). **Therefore there must be a supply connected to (+0) for the SYNC-1A Accessory Card to be operational.**

The SYNC-1A Accessory Card used with a Six Supervised Control Module is limited to a maximum of three power supplies, therefore each circuit pair (+0/+1, +2/+3, +4/+5) must share a supply in order for all NACs to be powered. Due to supply sharing the maximum load on a Class A NAC is limited to 3A while the maximum load on a pair of Class B NACs is limited to 3A total.

NOTE: Power Supply Monitoring must be disabled (on the Control Module) when using the SYNC-1A Accessory Card on the Six Supervised Control Module.

Refer to the Six Supervised Control Module installation manual for more detail

regarding its configuration and wiring requirements.

To interconnect SYNC-1A Accessory Cards wire the Slave and Horn connections as shown in Figure 2. The slave wires will synchronize all NACs corresponding to the interconnected boards. Any SYNC-1A which has no connections to its slave in terminals will operate as a master. It will generate a signal which will be duplicated by all interconnected units downstream. The horn wires will enable horn control on all NACs corresponding to the interconnected boards.

Horn control also requires a silenceable NAC circuits to be wired to the horn in terminals of the master SYNC-1A Accessory Card as shown in Figure 3.

A maximum of 11 Slaves Sync-1A Cards can be connected to a Master Sync-1 Card, totalling 12.

NOTE: All references to power limited represent “Power Limited (Class 2)”.

CAUTION

All horn and slave wiring interconnecting SYNC-1A accessory cards must be contained within the same enclosure. If multiple enclosures are used they must be located within 20 feet of each other with all horn and slave wiring between enclosures routed inside of conduit. This conduit should be grounded metal containing no other field wiring.

FIGURE 3: HORN OPERATION



C0122-01



THE LIMITATIONS OF SOUNDER/STROBES

The sounder and/or strobe will not work without power. The sounder/strobe gets its power from the fire/security panel monitoring the alarm system. If power is cut off for any reason, the sounder/strobe will not provide the desired audio or visual warning.

The sounder may not be heard. The loudness of the sounder meets (or exceeds) current Underwriters Laboratories' standards. However, the sounder may not alert a sound sleeper or one who has recently used drugs or has been drinking alcoholic beverages. The sounder may not be heard if it is placed on a different floor from the person in hazard or if placed too far away to be heard over the ambient noise such as traffic, air conditioners, machinery or music appliances that may prevent alert persons from hearing the alarm. The sounder may not be heard by persons who are hearing impaired.

NOTE: Strobes must be powered continuously for sounder operation.

The signal strobe may not be seen. The electronic visual warning signal uses an extremely reliable xenon flash tube. It flashes at least once every second. The strobe must not be installed in direct sunlight or areas of high light intensity (over 60 foot candles) where the visual flash might be disregarded or not seen. The strobe may not be seen by the visually impaired.

The signal strobe may cause seizures. Individuals who have positive photoic response to visual stimuli with seizures, such as persons with epilepsy, should avoid prolonged exposure to environments in which strobe signals, including this strobe, are activated.

The signal strobe cannot operate from coded power supplies. Coded power supplies produce interrupted power. The strobe must have an uninterrupted source of power in order to operate correctly. System Sensor recommends that the horn and signal strobe always be used in combination so that the risks from any of the above limitations are minimized.

THREE-YEAR LIMITED WARRANTY

System Sensor warrants its enclosed product to be free from defects in materials and workmanship under normal use and service for a period of three years from date of manufacture. System Sensor makes no other express warranty for the enclosed product. No agent, representative, dealer, or employee of the Company has the authority to increase or alter the obligations or limitations of this Warranty. The Company's obligation of this Warranty shall be limited to the replacement of any part of the product which is found to be defective in materials or workmanship under normal use and service during the three year period commencing with the date of manufacture. After phoning System Sensor's toll free number 800-SENSOR2 (736-7672) for a Return Authorization number, send defective units postage prepaid to: System Sensor, Returns Department, RA

_____, 6581 Kitimat Road, Unit 6, Mississauga, Ontario L4N-7J6. Please include a note describing the malfunction and suspected cause of failure. The Company shall not be obligated to replace units which are found to be defective because of damage, unreasonable use, modifications, or alterations occurring after the date of manufacture. In no case shall the Company be liable for any consequential or incidental damages for breach of this or any other Warranty, expressed or implied whatsoever, even if the loss or damage is caused by the Company's negligence or fault. Some states do not allow the exclusion or limitation of incidental or consequential damages, so the above limitation or exclusion may not apply to you. This Warranty gives you specific legal rights, and you may also have other rights which vary from state to state.

