



6581 Kitimat Road, Unit 6, Mississauga, Ontario L5N-3T5
 1-800-SENSOR2, FAX: 905-812-0771
 www.systemsensor.ca

B200SA

Intelligent Sounder Base

This model is compatible with Sytem Sensor Models MDLA, MDL3RA, MDLWA, MDL3WA and SYNC-1A

Specifications

Base Diameter:	6.875" (17.46 cm)
Base Height (less sensor):	2.0" (5.08 cm)
Weight:	0.50 lb. (227 gm)
Operating Temperature Range:	32° to 150°F (0° to 66°C)
Operating Humidity Range:	10% to 93% relative humidity (non-condensing)

External Supply Electrical Ratings

External Supply Voltage:	16 to 33 VDC (VFWR)
Standby Current:	500 µA maximum
Alarm Current:	40mA Max. (DC) 70mA Max. (FWR)

SLC Electrical Ratings

SLC Operating Voltage:	15 to 32 VDC
SLC Standby Current:	300 µA maximum

Sound Output

High Volume:	Greater than 87 dBA minimum measured in a ULC anechoic room at 10 feet, 24 Volts (in continuous tone)
Low Volume:	Greater than 85 dBA minimum measured in a ULC anechoic room at 10 feet, 24 Volts (in continuous tone)

BEFORE INSTALLING

Please read the System Sensor Smoke Detector Application Guide, which provides detailed information on sensor spacing, placement, zoning, wiring, and special applications. Copies of this manual are available from System Sensor. CAN/ULC S524 and NEMA guidelines should be observed.

NOTICE: This manual should be left with the owner/user of this equipment.

IMPORTANT: The detector used with this base must be tested and maintained regularly following CAN/ULC S536 requirements. The detector should be cleaned at least once a year.

GENERAL DESCRIPTION

The B200SA sounder base is used with System Sensor 200-Series sensor heads or equivalent. For a list of compatible sensors, refer to the System Sensor website at www.systemsensor.com. Refer to the appropriate manual for more information on sensors.

The B200SA sounder base was designed specifically to meet the needs of dwelling unit applications. It offers maximum flexibility in configuration and operation to meet or exceed the requirements of CAN/ULC S525 and CAN/ULC S529.

The sounder base is capable of producing a variety of tone patterns, including the distinctive three-pulse temporal pattern (ANSI Temporal 3) fire alarm signal now required by ULC for commercial and residential applications.

The B200SA can be commanded by the Fire Alarm Control Panel to adopt the address of the attached sensor head, but as a unique device type on the loop. By using the address, the fire alarm control panel can command an individual sounder base to activate, or a group of sounders in a suite or other multi-room configuration. The command set from the panel can be tailored to the specific event, allowing selection of volume, tone, and group. The device offers two volume levels. The available tones are Continuous, ANSI Temporal 3, and March Time. In addition, some fire alarm panels will offer the ability to command a custom tone pattern. Refer to the appropriate fire alarm control panel manual for more information.

The B200SA can be silenced remotely by using a ULC listed remote silence switch model RSM-1SWA. When operated, the base will be silenced for not more than 10 minutes after which time the base will resound if the system is still in alarm. The Fire Alarm Control Panel can also resound the base. The B200SA also has a silence test feature. If when the base is sounding the silence switch is pressed and held for more than 5 seconds and then released, the base will silence but resound after 10 seconds.

In addition, the B200SA is equipped with the circuitry to recognize the System Sensor synchronization protocol, enabling the sounder base to be used as a component of the general evacuation signal – producing a ULC compliant Temporal 3 pattern in synchronization with other System Sensor notification devices. This requires connection to a power supply capable of generating the System Sensor synchronization pulses. In this scenario, the sounder bases will have the ability to synchronize with other System Sensor horns, horn/strobes, and chimes using the same power source.

The sounder base is intended for use with intelligent systems. The sounder base requires an external 24 VDC power supply. The connections for the external power supply and the communication loop are isolated to prevent electrical interaction between them. Refer to the panel manual for maximum allowable number of units per loop.

NOTE: For ULC Installations, the Temporal 3 tone at high volume should be used for evacuation. The use of other tone styles and low volume level will be at the discretion of the local Authority Having Jurisdiction (AHJ).

NOTE: When not used as a supplementary evacuation system, the external 24 VDC supply shall be treated as a component of the main power supply system and shall fall under the requirements of the main power supply system per ULC.

WIRING GUIDELINES

All wiring must be installed in compliance with the Canadian Electrical Code and the local codes having jurisdiction and must not be of such length or wire size which would cause the base to operate outside of its published specifications. The conductors used to connect smoke sensors to control panels and accessory devices should be color coded to reduce the likelihood of wiring errors. Improper connections can prevent a system from responding properly in the event of a fire.

FIGURE 1:


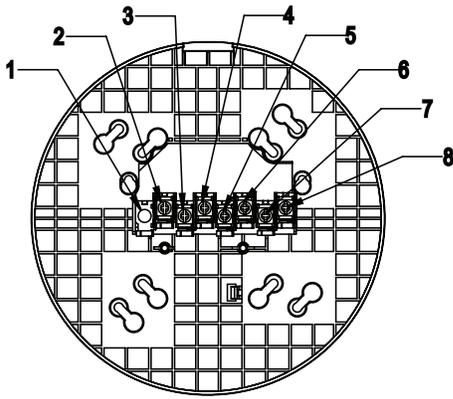


FIGURE 2:

C0471-02

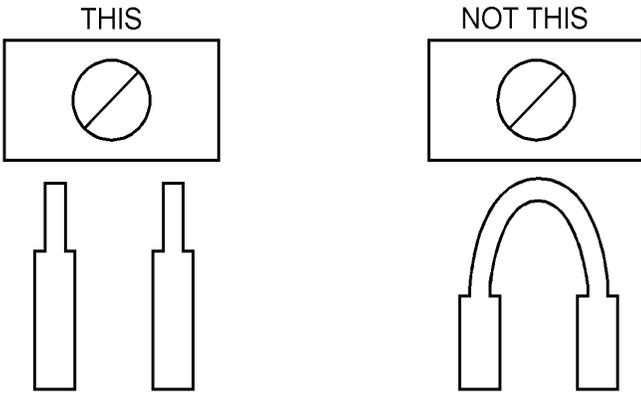

C0473-00

Wire sizes up to 12 AWG (2.5 mm²) may be used with the base. The sounder base will be shipped with the screw terminals set for 14 AWG wiring. If 12 AWG wire is to be used, back out the screws to allow the wire to fit beneath the clamping plates. For best system performance, the power (+ and -) wires and the communication circuit wires should be twisted pair or shielded cable installed in a separate grounded conduit to protect the communication loop from electrical interference.

Make wire connections by stripping about 3/8" of insulation from the end of the wire. Then, slide the bare end of the wire under the appropriate clamping plate (See Figure 1), and tighten the clamping plate screw. Do NOT loop the wire under the clamping plate (See Figure 2). The wiring diagram for a typical 2-wire intelligent system is shown in Figure 4.

CAUTION

For system monitoring - for terminals 2, 3, 4, and 5, do not use looped wire under terminals. Break wire run as shown in Figure 2 to provide monitoring of connections.

B200SA TERMINALS

- | No. | Function |
|-----|------------------------------------|
| 1. | Not Used |
| 2. | Positive (+) Comm. Line In and Out |
| 3. | Negative (-) Comm. Line In and Out |
| 4. | External Supply Positive (+) |
| 5. | External Supply Negative (-) |
| 6. | Remote Annunciator |
| 7. | Hush + |
| 8. | Hush - |

MOUNTING

Mount the B200SA mounting plate directly to an electrical box. The plate will mount directly to 4" square (with or without plaster ring), 4" octagon, 3 1/2" octagon, single gang or double gang junction boxes.

1. Connect field wiring to terminals, as shown in Figure 1 and 2.
2. Attach the mounting plate to the junction box as shown in Figure 3.
3. To mount the sounder base, hook the tab on the sounder base to the groove on the mounting plate.
4. Then, swing the sounder base into position to engage the pins on the product with the terminals on the mounting plate.
5. Secure the sounder base by tightening the mounting screws.
6. Install a compatible smoke sensor as described in the installation manual for the sensor.

TESTING AND MAINTENANCE

Sensors and bases must be tested after installation and as an integral part of a periodic maintenance program. Test the B200SA as follows:

NOTE: Before testing, notify the proper authorities that the smoke sensor system is undergoing maintenance and, therefore, will be temporarily out of service. Disable the system undergoing maintenance to prevent unwanted alarms.


1. Via the fire alarm control panel, command the individual B200SA to activate using the associated sensor address. That sounder base should sound in approximately five seconds.
2. Via the fire alarm control panel, command all B200SA sounder bases to activate using group communication to all associated addresses. All devices on the loop should sound, and if a temporal tone is commanded, the tones can be synchronized to each other.

NOTE: Synchronization requires a power supply capable of producing the System Sensor synchronization pulses.

When performing maintenance on connected smoke sensors, carefully note the location and address of each removed sensor. When re-installed, the B200SA will confirm that address of the sensor matches the address stored in the sounder base memory. If there is a mismatch, this will be communicated to the fire alarm control panel and the sounder base can be commanded to chirp at regular intervals until the correct head is installed.

If a replacement head is installed or address changes are required, the mismatch may be resolved at the panel by commanding the B200SA sounder base to re-enter its address learning mode and adopting the address of the new sensor.

FIGURE 3: MOUNTING

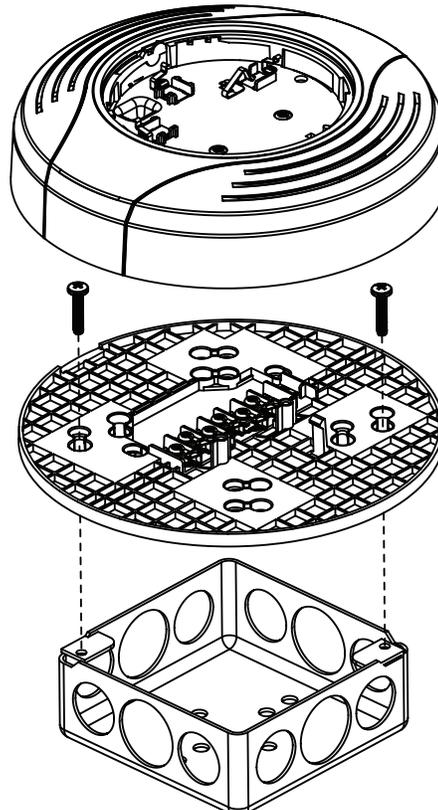

C0891-01

Please refer to insert for the Limitations of Fire Alarm Systems

THREE-YEAR LIMITED WARRANTY

System Sensor warrants its enclosed smoke detector base to be free from defects in materials and workmanship under normal use and service for a period of three years from date of manufacture. System Sensor makes no other express warranty for this smoke detector base. No agent, representative, dealer, or employee of the Company has the authority to increase or alter the obligations or limitations of this Warranty. The Company's obligation of this Warranty shall be limited to the repair or replacement of any part of the smoke detector base which is found to be defective in materials or workmanship under normal use and service during the three year period commencing with the date of manufacture. After phoning System Sensor's toll free number 800-SENSOR2 (736-7672) for a Return Authorization number, send defective units postage prepaid

to: System Sensor, Returns Department, RA # _____, 6581 Kitimat Road, Unit 6, Mississauga, Ontario L5N-3T5.. Please include a note describing the malfunction and suspected cause of failure. The Company shall not be obligated to repair or replace units which are found to be defective because of damage, unreasonable use, modifications, or alterations occurring after the date of manufacture. In no case shall the Company be liable for any consequential or incidental damages for breach of this or any other Warranty, expressed or implied whatsoever, even if the loss or damage is caused by the Company's negligence or fault. Some states do not allow the exclusion or limitation of incidental or consequential damages, so the above limitation or exclusion may not apply to you. This Warranty gives you specific legal rights, and you may also have other rights which vary from state to state.