SILENT KNIGHT
by Honeywell

ECS-50WBU Installation Instructions

The ECS-50WBU provides backup capability when operating the ECS-DUAL50W in the 100 watt with backup mode for both single and dual channel setups.

Compatibility

The ECS-50WBU is compatible with the Silent Knight IFP-2000ECS, IFP-1000ECS and IFP-100ECS FACPs.

Mounting and Wiring

The ECS-50WBU mounts above the ECS-DUAL50W board on the standoffs provided.

1. Remove AC power from the ECS-DUAL50W.
2. Disconnect the backup batteries from the ECS-DUAL50W.
3. Connect one end of the supplied wiring harness (P/N 50116775-001) from the connector labeled “Backup Amplifier” on the ECS-DUAL50W to the connector on the ECS-50WBU as shown in Figure 2.
4. Using the 4 supplied screws, mount the ECS-50WBU to the standoff's as shown in Figure 2.
5. Restore AC Power.
6. Reconnect backup batteries.

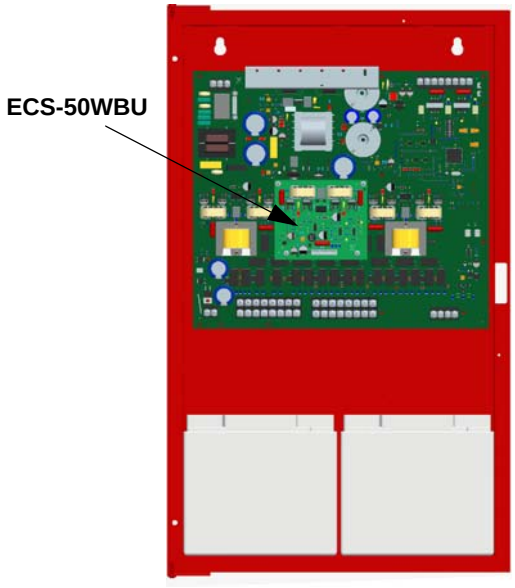


Figure 1 Mounting Location for the ECS-50WBU

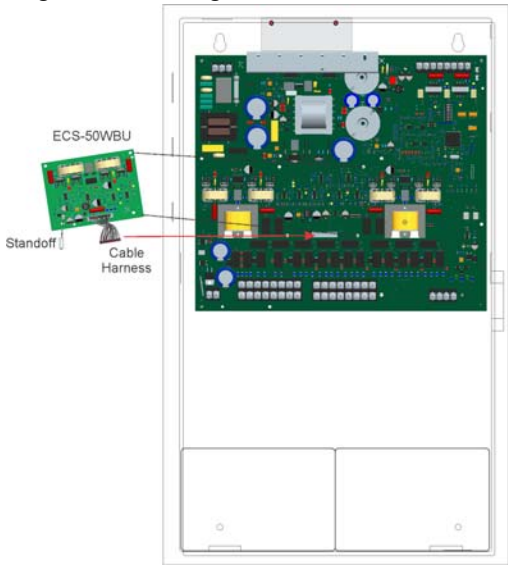


Figure 2 Wiring Harness Connection

SILENT KNIGHT
by Honeywell

12 Clintonville Road
Northford, CT 06472-1610 USA
203-484-7161
Fax: 203-484-7118
www.silentknight.com

© 2013 Honeywell International Inc.

P/N LS10059-001SK-E Rev A
ECN: 12-0880