

GENT by Honeywell

INSTALLATION INSTRUCTIONS FOR THE MANUAL CALL POINT MODELS XENS-800, XENS-801, XENS-805, XENS-842, XENS-850


TO TEST & RESET

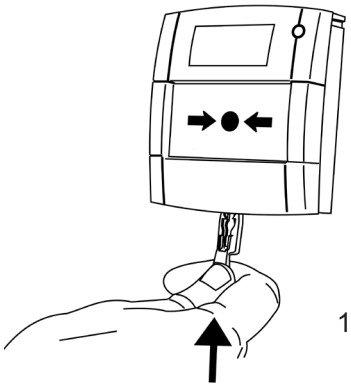

1

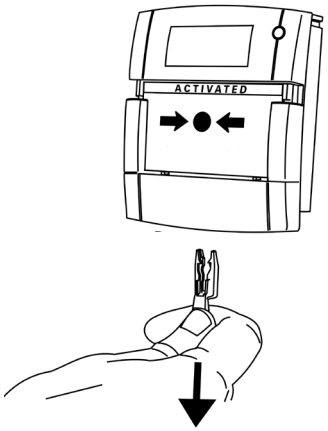


2

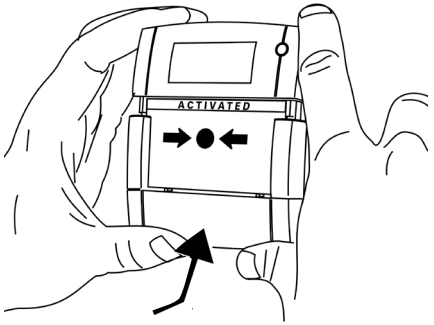


3


TO REPLACE GLASS / INTERCHANGE BETWEEN RESETTABLE AND GLASS ELEMENT

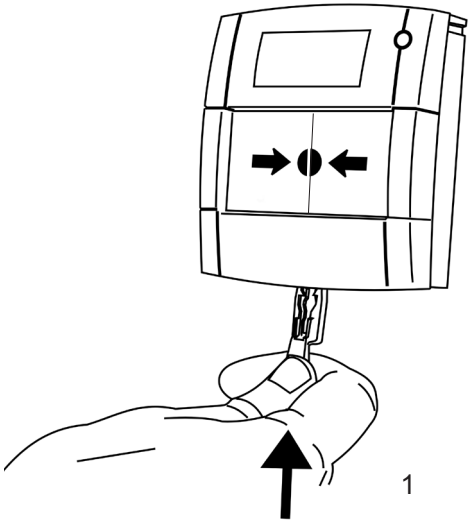


1

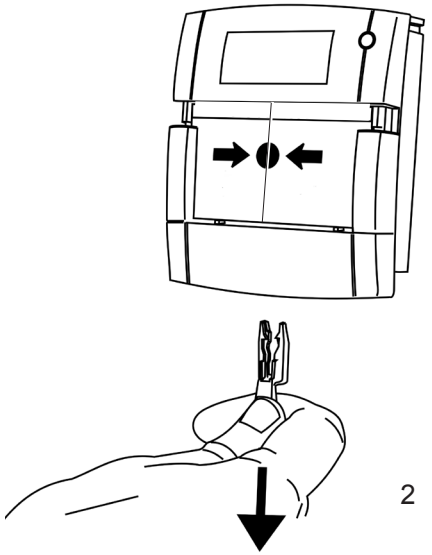


2

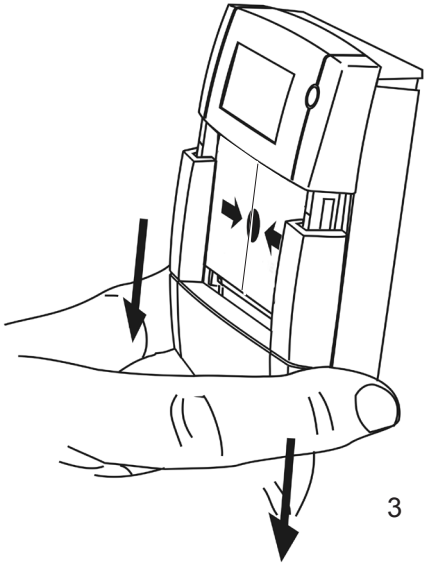


3

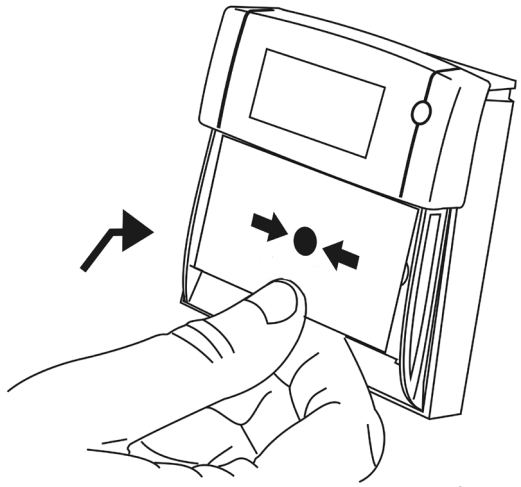

4

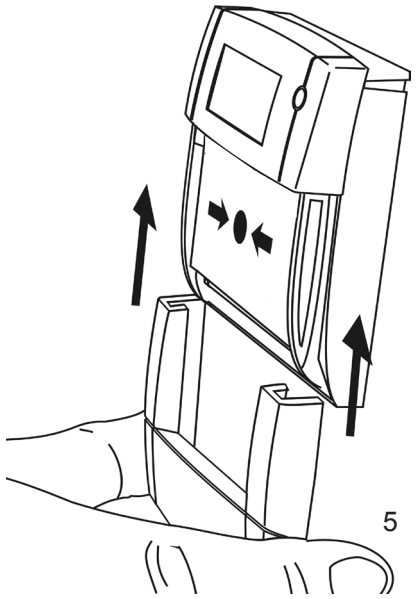

5

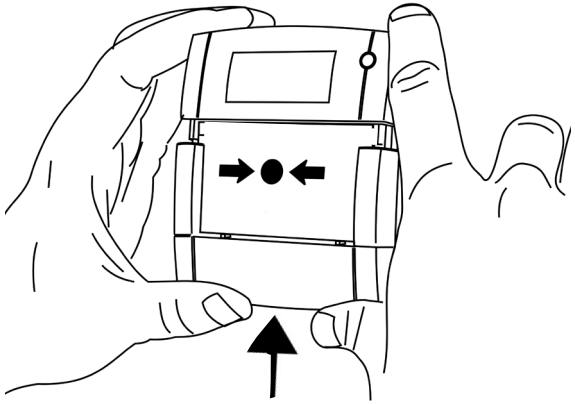

6


GENT BY HONEYWELL, 140 Waterside Road, Hamilton Industrial Park, Leicester, Leicestershire, England. LE5 1TN. T. +44 (0) 116 246 2000 F. +44 (0) 116 246 2300 www.gent.co.uk

GENT by Honeywell


INSTALLATION INSTRUCTIONS FOR THE MANUAL CALL POINT MODELS XENS-800, XENS-801, XENS-805, XENS-842, XENS-850

CONNECTION DETAILS

XENS-800, XENS-805 XENS-842, XENS-850	XENS-***	XENS-***	XENS-***

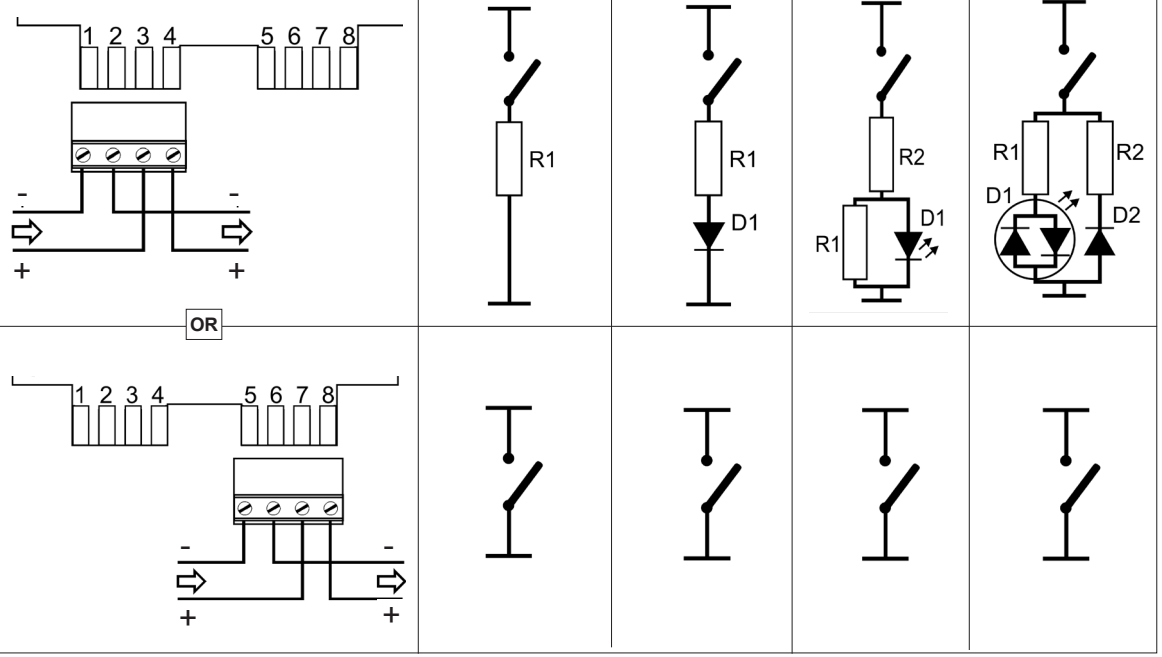


DIMENSIONS

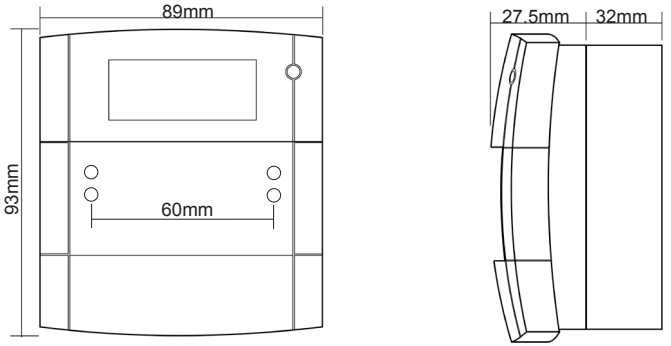


PUSH FIT CONNECTOR


After wiring the terminal connector, plug into the appropriate position, see connection details (left).

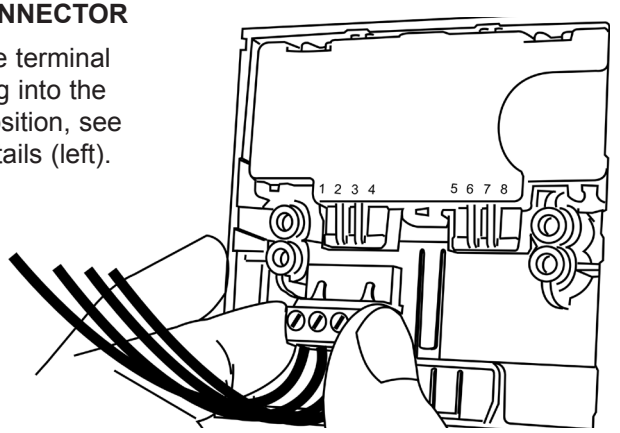

CONNECTION DETAILS XENS-801

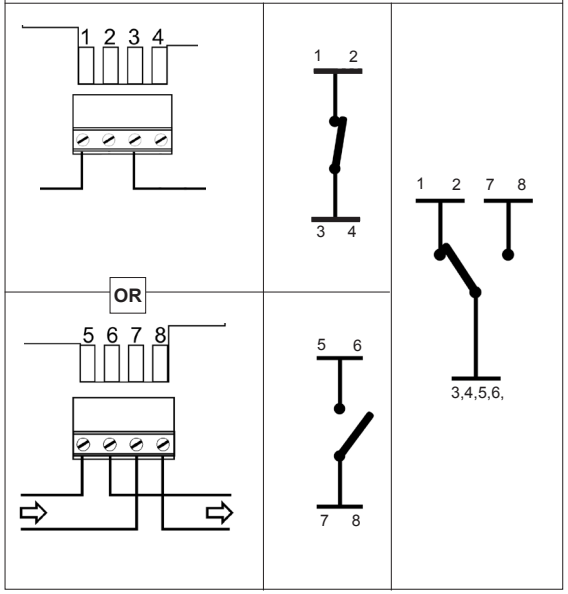

CONNECTION DETAILS XENS-***

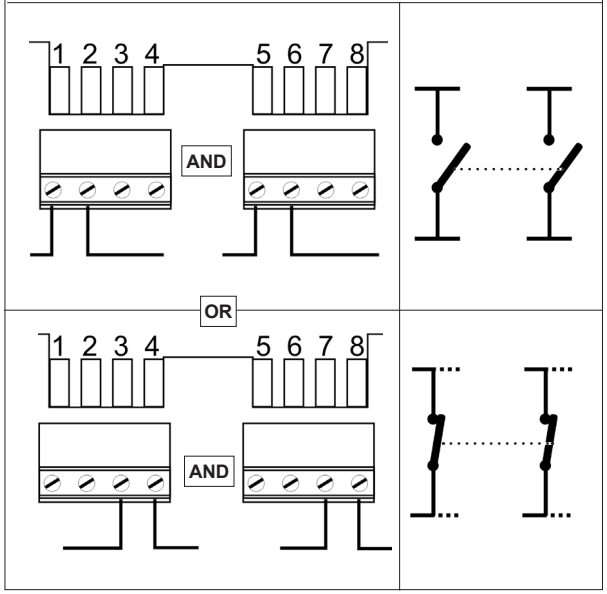

TECHNICAL DATA

- 30VDC Max
- 2A Max
- IP24D
- 110/160g
- -10^{0}C to 55^{0}C

Red, Ral 3001
Yellow, Ral 1006
Green, Ral 6016
White, Ral 9010
Blue, Ral 5002

Important Notes; -
Please do not over tighten fixing screws.
The use of lubricants, cleaning solvents or petroleum based products should be avoided.

Note: For CPD Data on all relevent devices please request D974

We reserve the right to amend the content of this document without prior notice.