# **ECS-VCM**

# Voice Control Module

#### Product Installation Document

#### 1 Description

The ECS-VCM Voice Control Module is contained within the Farenhyt ECS Series panel enclosure. It provides a supervised microphone for live communication and an interface for the Emergency Communication System.



**NOTE:** Installation and wiring of this device must be done in accordance with NFPA 72 and local ordinances.

#### 2 Compatibility

The ECS-VCM is compatible with the following Honeywell Farenhyt Series FACPs:

- IFP-2000ECS (P/N 151430-L8)
- IFP-1000ECS (PN 151460)
- IFP-100ECS (PN 151458)



**NOTE:** For programming and DIP switch settings, refer to the *FACP Manual*.

#### 3 Specifications

Standby Current: 70mAAlarm Current: 100mA

## 4 Board Layout and Mounting

- 1. Open the cabinet door and the dead front panel.
- Remove AC power and disconnect the backup batteries from the main control panel.

Mount the ECS-VCM in the middle section of the dead front on the six mounting studs. See Figure 1 for hole locations and Figure 4 for board mounting location.

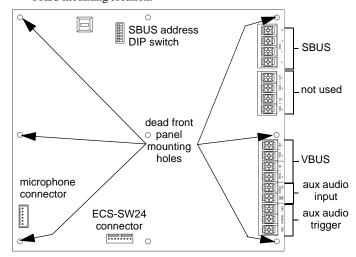


Figure 1 Back View of ECS-VCM

### 5 Wiring to an FACP

Figure 2 belows shows how to properly wire the ECS-VCM to the FACP SBUS.

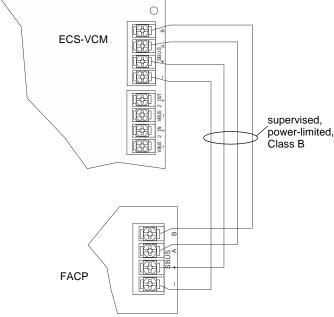


Figure 2 Wiring the ECS-VCM to the FACP

#### 5.1 Installing the Microphone

1. Clip the microphone onto the microphone clip.




Figure 3 Hang Microphone onto Microphone Clip

Insert microphone cord through hole at the bottom of the dead front panel.




Figure 4 Microphone Cord Inserted Through Dead Front Panel Hole

3. Attach strain relief clip to microphone cord. The strain relief clip should have about 2.75" of microphone cord through it.

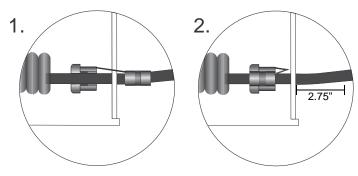


Figure 5 Installing Strain Relief Clip

- 4. Push the strain into the hole in the dead front panel.
- 5. Attach connector to the ECS-VCM board.
- 6. Restore AC power and reconnect the backup batteries.