

12 Clintonville Road, Northford, CT 06472-1610  
 Phone: 203-484-7161 Fax: 203-484-7118  
 www.Farenhyt.com

**IDP-Zone Interface Module**

**SPECIFICATIONS**

Normal Operating Voltage:	15 to 32 VDC
Maximum Current Draw:	5.1 mA (LED on)
Average Operating Current:	270 µA (LED flashing)
EOL Resistance:	3.9K Ohms
Maximum IDC Wiring Resistance:	25 Ohms
External Supply Voltage (between Terminals T10 and T11)	
Regulated DC Voltage:	24 VDC power limited
Ripple Voltage:	0.1 Volts RMS maximum
Alarm Current:	90 mA per module
Standby Current:	13 mA Maximum @24 VDC
Temperature Range:	32°F to 120°F (0°C to 49°C)
Humidity:	10% to 93% Non-condensing
Dimensions:	4.5" H × 4" W × 1.25" D (Mounts to a 4" square by 2.125" deep box.)
Accessories:	SMB500 Electrical Box

**BEFORE INSTALLING**

This information is included as a quick reference installation guide. Refer to the control panel installation manual for detailed system information. If the modules will be installed in an existing operational system, inform the operator and local authority that the system will be temporarily out of service. Disconnect power to the control panel before installing the modules.

NOTICE: This manual should be left with the owner/user of this equipment.

**GENERAL DESCRIPTION**

The IDP-Zone Interface Module is intended for use in intelligent, two-wire systems, where the individual address of each module is selected using the built-in rotary switches. This module allows intelligent panels to interface and monitor two-wire conventional smoke detectors. It transmits the status (normal, open, or alarm) of one full zone of conventional detectors back to the control panel. All two-wire detectors being monitored must be UL compatible with this module.

**COMPATIBILITY REQUIREMENTS**

To ensure proper operation, this module shall be connected to a compatible Honeywell Farenhyt series system control panel only (list available from Honeywell).

**MOUNTING**

The IDP-Zone mounts directly to 4-inch square electrical boxes. (See Figure 2.) The box must have a minimum depth of 2.125 inches. Surface mounted electrical boxes (SMB500) are available from Honeywell.

**WIRING**

NOTE: All wiring must conform to applicable local codes, ordinances, and regulations. This module is intended for power-limited wiring only.


1. Install module wiring in accordance with the job drawings and appropriate wiring diagrams.
2. Set the address on the module per job drawings.
3. Secure module to electrical box supplied by installer. (See Figure 2.)

**COMPATIBLE TWO-WIRE SYSTEM SENSOR SMOKE DETECTORS FOR USE WITH IDP-ZONE INTERFACE MODULE WITH ZONE IDENTIFIER A**

Detector Model	Compatibility ID	Detector Type	Base Model	Base Identifier	Max Detectors
1451	A	Ionization	B401/B	A	20
2451	A	Photoelectric	B401/B	A	20
2451TH	A	Photoelectric with Thermal	B401/B	A	20
1400	A	Ionization	N/A	—	20
2400	A	Photoelectric	N/A	—	20
2400TH	A	Photoelectric with Thermal	N/A	—	20
1100	A	Ionization	N/A	—	20
1151	A	Ionization	B110LP/B401	A	20
2100	A	Photoelectric	N/A	—	20
2100T	A	Photoelectric with Thermal	N/A	—	20
2151	A	Photoelectric	B110LP/B401	A	20


\*Used in combination with MTL isolator model MTL3043.

**FIGURE 1. CONTROLS AND INDICATORS**




C1059-00

**FIGURE 2. MODULE MOUNTING**

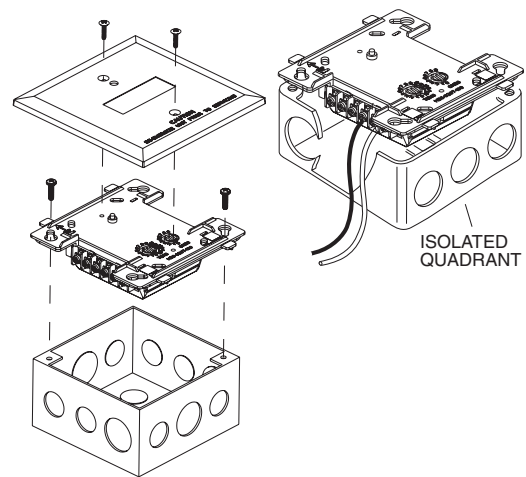


C1066-00

**FIGURE 3. INTERFACE TWO-WIRE CONVENTIONAL DETECTORS, NFPA CLASS B**

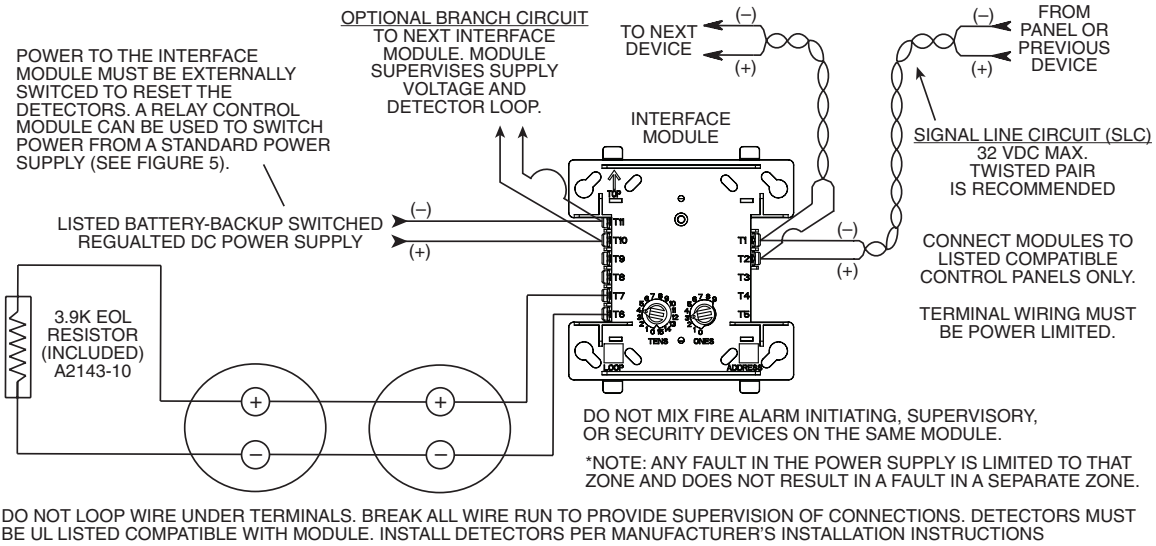


C1061-00

**FIGURE 4. INTERFACE TWO-WIRE CONVENTIONAL DETECTORS, NFPA CLASS A**

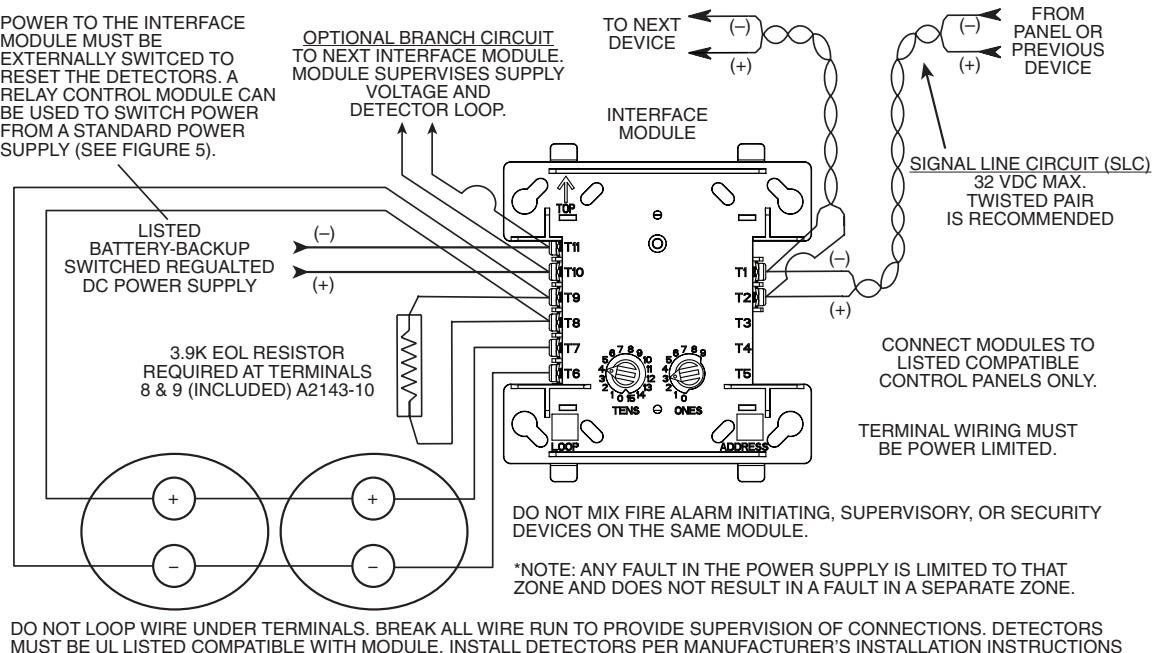

C1062-00

**FIGURE 5. RELAY CONTROL MODULE USED TO DISCONNECT A POWER SUPPLY**

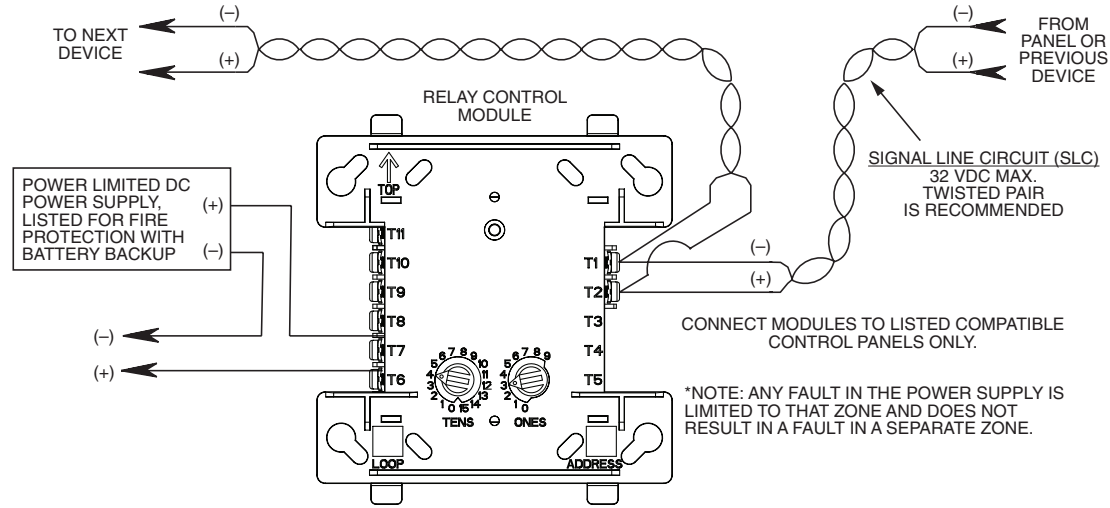

C0945-00

Farenhty™ is a trademark of and System Sensor® and Honeywell® are registered trademarks of Honeywell International, Inc.