



World Headquarters
12 Clintonville Rd., Northford, CT 06472-1653 USA
203-484-7161 • Fax 203-484-7118
www.notifier.com

Insulating Pad

Product Installation Drawing
P/N 50389 Rev B ECN 01-435 08/09/01


Overview

Installing an Insulating Pad (PN 43294) on a module prevents short circuits in voice messaging systems that use 16-point or 32-point annunciators (ACM-16AT, ACM-32A, and their expanders). Install an Insulating Pad on one of these annunciators installed in front of an audio amplifier (AA-30) mounted on a Dress Panel Single Well (DPSW-1/1B). The following instructions show how to install an Insulating Pad on a module and where to mount the module on the DPSW-1/1B (PN 18352).

Installing an Insulating Pad

Install an Insulating Pad on the back of a 16-point or 32-point annunciator as follows:


- 1) Remove the three mounting screws on the back of the module.
- 2) Place the Insulating Pad on the back of the module.
- 3) Insert the mounting screws and tighten until secure.

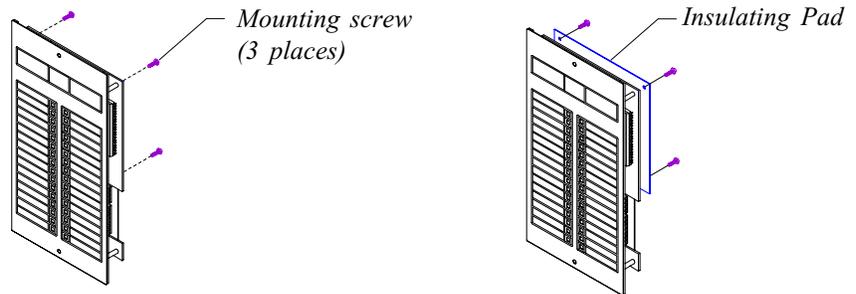

Installing an Insulating Pad

Mounting a Module with an Insulating Pad

Mount a 16-point or 32-point annunciator with an Insulating Pad onto the DPSW-1/1B in the outside position as shown in the following illustration. Modules mounted in the other position do not need an insulating pad.

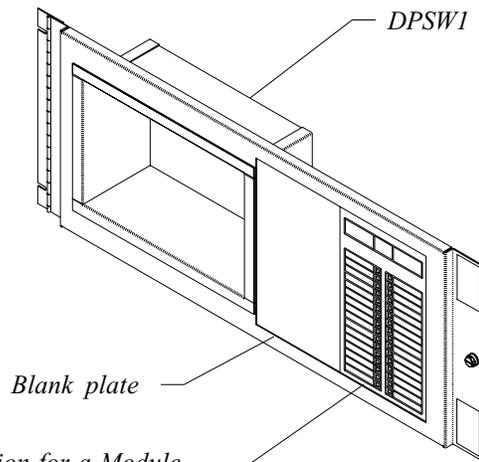

Mounting position for a Module with an Insulating Pad

Mounting a Module with an Insulating Pad