




HVAC400	
	
1.1...160 kW Integrierte Kommunikation: BACnet MS/TP, BACnet IP, Modbus RTU, Modbus TCP, Metasys N2 Optional: LONWORKS Emissionen: EN61800-3 Kat. C2 Sprachen: central-southern EU	
Bestellnummer	kw
HVAC400-1P1-21A	1.1
HVAC400-1P1-54A	1.1
HVAC400-1P5-21A	1.5
HVAC400-1P5-54A	1.5
HVAC400-2P2-21A	2.2
HVAC400-2P2-54A	2.2
HVAC400-3P0-21A	3.0
HVAC400-3P0-54A	3.0
HVAC400-4P0-21A	4.0
HVAC400-4P0-54A	4.0
HVAC400-5P5-21A	5.5
HVAC400-5P5-54A	5.5
HVAC400-7P5-21A	7.5
HVAC400-7P5-54A	7.5
HVAC400-11P-21A	11.0
HVAC400-11P-54A	11.0
HVAC400-15P-21A	15.0
HVAC400-15P-54A	15.0
HVAC400-18P-54A	18.0
HVAC400-18P-21A	18.5
HVAC400-22P-21A	22.0
HVAC400-22P-54A	22.0
HVAC400-30P-21A	30.0
HVAC400-30P-54A	30.0
HVAC400-37P-21A	37.0
HVAC400-37P-54A	37.0
HVAC400-45P-21A	45.0
HVAC400-45P-54A	45.0
HVAC400-55P-21A	55.0
HVAC400-55P-54A	55.0
HVAC400-75P-21A	75.0
HVAC400-75P-54A	75.0
HVAC400-90P-21A	90.0
HVAC400-90P-54A	90.0
HVAC400-110-21A	110.0
HVAC400-110-54A	110.0
HVAC400-132-21A	132.0
HVAC400-132-54A	132.0
HVAC400-160-21A	160.0
HVAC400-160-54A	160.0

Türmontage-Set
HVAC-DOOR-KIT

HVAC232/402	
	
1.1...18.5 kW IP20/21 Integrierte Kommunikation: Modbus RTU Optional: LONWORKS Emissionen: EN61800-3 Kat. C2	
Bestellnummer	kw
208-240V, 1 ~ Version IP20/21	
HVAC232-P37-20	0.37
HVAC232-P55-20	0.55
HVAC232-P75-20	0.75
HVAC232-1P1-20	1.1
HVAC232-1P5-20	1.5
HVAC232-2P2-20	2.2
380-480V, 3 ~ Version IP20/21	
HVAC402-P55-20	0.55
HVAC402-P75-20	0.75
HVAC402-1P1-20	1.1
HVAC402-1P5-20	1.5
HVAC402-2P2-20	2.2
HVAC402-3P0-20	3
HVAC402-4P0-20	4


Abdeckungen (optional)	
ENC-Slot-MI 1...3	≤5.5 kW

Türmontage-Set
HVACDOORKIT

NXL	
	
1.1...30 kW Integrierte Kommunikation: Modbus RTU Optional: LONWORKS, BACnet MS/TP, Modbus TCP, CANopen, Devicenet, Metasys N2 Emissionen: EN61800-3 Kat. C1 → IP54	
Bestellnummer	kw
HVAC03C5	1.1
HVAC04C5	1.5
HVAC05C5	2.2
HVAC07C5	3.0
HVAC09C5	4.0
HVAC12C5	5.5
HVAC16C5	7.5
HVAC23C5	11.0
HVAC31C5	15.0
HVAC38C5	18.5
HVAC46C5	22.0
HVAC61C5	30.0

Türmontage-Set
DRA-02L, 2 m
DRA-04L, 4 m

Frequenzumrichter Zubehör

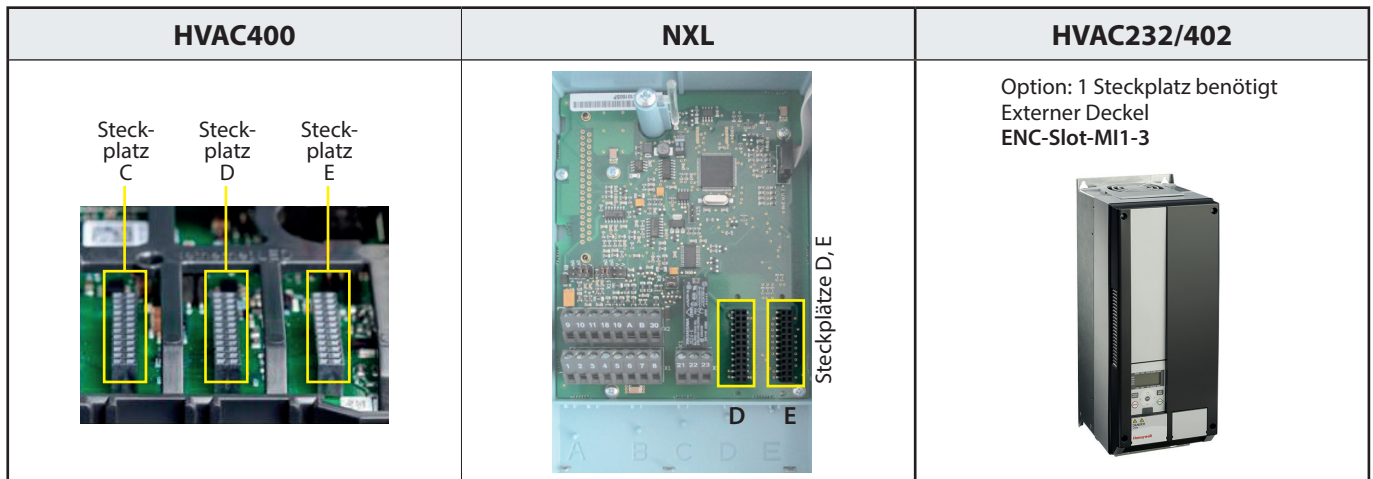

Kommunikation	HVAC400	NXL	HVAC232/402	Steckplatz	Bestellnummer
LONWORKS	▲	▲	–	C, D	OPTC4
Modbus/N2 (RS-485)	■	■	–	C, D	NXOPTC2
Profibus DP	–	▲	–	C, D	NXOPTC3
CANopen (slave)	–	▲	–	C, D	NXOPTC6
DeviceNet	■	▲	–	C, D	NXOPTC7
BACnet MS/TP	■	▲	–	C, C	NXOPTCJ
Modbus TCP Ethernet/IP	–	–	▲*	DE	OPTE9

E/A Module	HVAC400	NXL	HVAC232/402	Steckplatz	Bestellnummer
6× inputs/outputs progr.	▲	–	▲*	B, C, D, E	OPTB1
2 AO & 1 AI mA	▲	▲	▲*	B, C, D, E	OPTB4
3× Relays	▲	▲	▲*	B, C, D, E	OPTB5
1× RO, 5× inputs 42...240 V	▲	–	▲*	B, C, D, E	OPTB9
1 AI mA, 1RO, 1DO op. col.	▲	–	▲*	D, E	OPTBF
3× DI, 1× Relay, 1× DO	–	▲	–	D, E	NXLOPTAA
1 Thermistor, 2× RO	■	–	▲*	E	OPTB2
PT1000, Ni1000, KTY84x	▲	–	▲*	B, C, D, E	OPTBH

■ = eingebaut ▲ = passt ▲* = Benötigt Option ENC-Llot-MI1-3

Kommunikation mit PC	Bestellnummer
HVAC400, HVAC232/402, 3 m Kabel	SMARTDRIVE- USBC
Interface required for HVAC232/402 PC Kommunikation	COMP-LOADER

Saia-Burgess Controls AG
Bahnhofstrasse 18
3280 Murten
Schweiz
T +41 26 580 30 00
F +41 26 580 34 99
www.saia-pcd.com

info.ch@saia-pcd.com
www.sbc-support.com

Saia Burgess Controls
9 avenue du Marais
Parc des Algorithmes
Bâtiment Sophocle
95100 Argenteuil | Frankreich
T + 33 1 39 96 49 59
F + 33 1 39 96 49 91
www.saia-pcd.fr

info.fr@saia-pcd.com
www.sbc-support.com

Honeywell B.V. | Honeywell NV
Saia Burgess Controls
Hanzeweg 12c
2803 MC Gouda
Nederland
T +31 182 54 31 54
www.saia-pcd.nl

info.bnl@saia-pcd.com
www.sbc-support.com