

Fire Alarm Document Boxes for Code Compliance – NOW AVAILABLE in US

October 2018

Fire Alarm Documents boxes are the perfect fit to meet the demanding code requirements for critical data record keeping related to the fire alarm system. Today there are many sites that place this data inside the live fire alarm cabinet, which are not easily accessible. **NFPA code now requires these boxes to independently exist next to the fire alarm panel.**

NFPA 72 2007 6.2.2.1

"A record of installed software and firmware version numbers shall be maintained at the location of the fire alarm control unit."

NFPA 72 2013 7.7.2.1

"With every new system, a documentation cabinet shall be installed at the system control unit or other approved location at the protected premises."

NFPA 72 2013 7.7.2.4

A cabinet must be "*prominently labelled 'SYSTEM RECORD DOCUMENTS'.*"

NOTIFIER now offers two new fire alarm document boxes that solve this problem.

NF-FAD: Fire Alarm Document Cabinet with NOTIFIER Lock

NF-SRD: Systems Record Document Cabinet with NOTIFIER Lock



These durable 16-gauge steel enclosures with a solid piano hinge and key lock will keep your code required documents in one safe place. With a 4GB USB flash drive, it safely and securely stores your fire alarm software - eliminating the occurrences of the software not being on site. Using a standard USB B connector, it allows you to plug in with any standard SB printer cable to upload or download information.

Along with your fire alarm software you can store system test & inspection documents, service records, manuals & AS built drawings. The document box also includes designated hooks to organize key rings and a business card placeholder. Inside the cover, it has an organized note table to document passwords and other critical system information.

Datasheets are available to download from the NOTIFIER website (DN-61031:A, DN-61032:A) so you can start specifying this required piece of equipment. Please contact Customer Service for ordering information.

Thank you for your continued support and business!

Julie Laudano
Channel Marketing Manager
NOTIFIER, US

Fire Alarm Documents (FAD) Cabinet Fire Alarm Storage Cabinet

Description

The Notifier Fire Alarm Documents Cabinet (FAD) is the perfect solution to meet the demanding code standards required today. Notifier's primary goal is to manufacture code compliant solutions and this product allows you to do just that. This cabinet is the answer to comply with the NFPA 72 2007, Section 6.2.2.1 requirements which states, "A record of installed software and firmware version numbers shall be maintained at the location of the fire alarm control unit."

The Fire Alarm Documents cabinet may be used as a storage box for both printed and digital documentation, enabling you to store the system's test and certified inspection documents, service records, manuals and AS built drawings.

This cabinet is constructed of durable 16 gauge steel with a solid piano hinge and key lock. The cabinet includes a 4GB USB memory flash drive interface. Using a standard USB B connector, the USB flash drive interface allows you to use any standard USB printer cable to upload or download information. This feature allows you to store the fire alarm software in one secure place, so that the Technician can easily access the software and service the system.

The Fire Document Box (FDB) interior is designed to contain critical manuals and documents. It is constructed with a durable steel retainer. The FDB has two key ring hooks to hold system keys, and a frame to insert Authorized personnel business cards. In the inner door, you can add the Legend Sheet to record property, system, service, code and AHJ certification information, as well as required documentation. (See Figure 2).

Features

- Installed with a 4 gigabyte digital flash drive interface with USB B connector.
- Overall Dimensions:
12" W x 13" H x 2 1/4" D (30.48 W x 33.02 H x 5.71 D cm).
- Offers two, key ring hooks to hold the system keys.
- Contains a frame plate to insert Authorized Personnel business cards.
- Constructed with 16 gauge steel box and cover for added security with a solid stainless steel hinge.
- Coated with a durable, baked-on finish (other colors available).
- Built with a stainless steel piano hinge with standard 3/4" cat 30 key lock (other lock assemblies available).
- Includes a Legend Sheet to record passwords and system information.
- Imprinted with white indelible ink, 1" high lettering labeled, "FIRE ALARM DOCUMENTS."

Specifications

FAD Fire Alarm Documents Cabinet Dimensions: 12"W x 13"H x 2 1/4" D, (30.48 W x 33.02 H x 5.71 D cm).

Door Keylock: Barrel lock and piano hinge. 3/4" barrel lock and 12" (30.48 cm) piano hinge.

FAD Cabinet: UL® Listed, constructed of 18 gauge cold rolled steel.

Cabinet Finish: Red powder coat epoxy finish

Cabinet Cover Label: Silkscreen imprinted with white indelible ink, 1" high lettering labeled, "FIRE ALARM DOCUMENTS"

Cabinet Keylock: Keylocked with 3/4" barrel lock and 12" (30.48 cm) width stainless steel piano hinge.



Cabinet Backbox: The backbox includes a 4-hole knockout mounting pattern.

Cabinet Frame Plate: Insert frame plate accommodates and protects standard 8 1/2 x 11 manuals and document records.

Cabinet Inner Door Label: Legend Sheet attached to the inner door frame for system required documentation, key contacts and code information.

Cabinet Flash Drive Interface: 4 Gigabyte (minimum) digital flash memory drive with a standard USB B connector (used to upload and download information) is securely assembled to the interior cabinet. The drive is restricted to Authorized personnel with permission to use secure hardware devices to access the records.

Cabinet Key Holder: Two key ring holders and a pre-assembled frame plate to insert Authorized Personnel business cards.

Standards

The Fire Alarm Documents (FAD) Cabinet is designed to comply with the following standard:

UL Standard: S2580

Agency Listings and Approvals

These listings and approvals apply to the modules specified in this document. In some cases, certain modules or applications may not be listed by certain approval agencies, or listing may be in process. Consult factory for latest listing status.

UL: S2580, Vol. 3

CSFM: 7300-0553-0110

NFPA: 72 2007

NEMA

ISO 9001 Certification

Ordering Information

NF-FAD: Fire Alarm Storage Cabinet, Red. Includes NOTIFIER lock.

Figure 1 shows the interior enclosure of the Fire Alarm Documents cabinet.

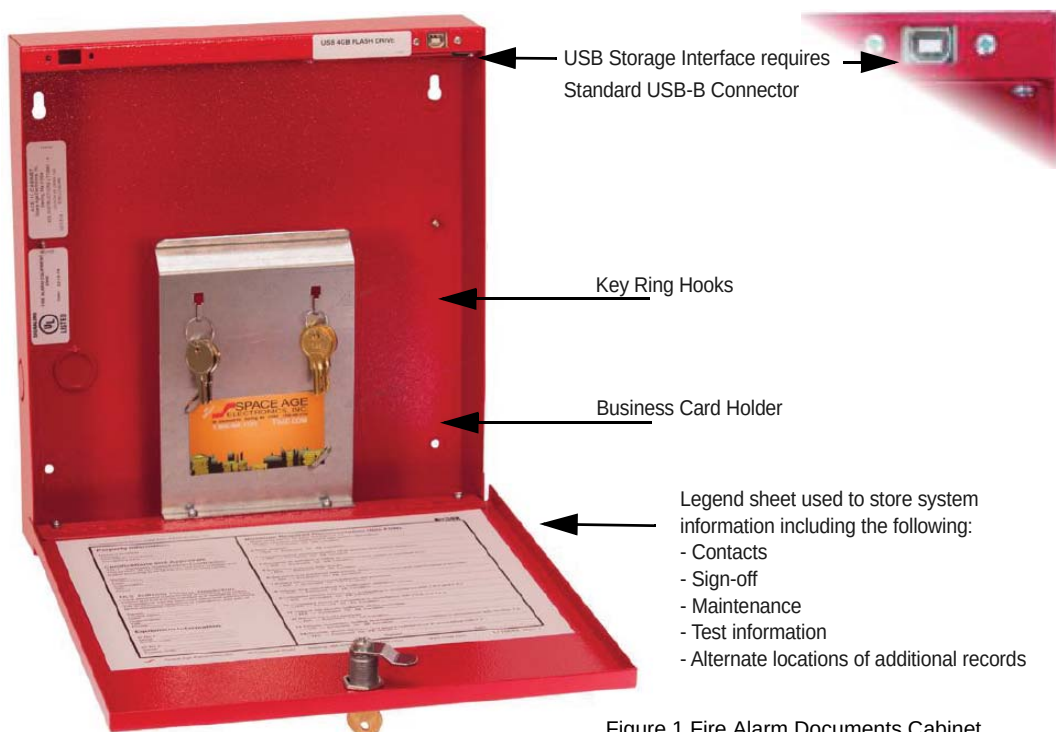


Figure 1 Fire Alarm Documents Cabinet

Figure 2 shows the Legend Sheet attached to the inner door of the Fire Alarm Document Cabinet.

Property Information	Minimum Required Documentation
Name of Property: _____	1 Written narrative providing intent and system description.
Address: _____	☐ N/A ☐ Enclosed or Alt. Location: _____
Description of Property: _____	2 Riser diagram
Occupancy Type: _____	☐ N/A ☐ Enclosed or Alt. Location: _____
Certification and Approvals	3 Floor plan layout showing location of all devices and control equipment.
16.1 System Installation Contractor:	☐ N/A ☐ Enclosed or Alt. Location: _____
This system, as specified herein, has been installed and tested according to all NFPA Standards cited therein.	4 Sequence of operation in either an input/ output matrix or narrative form.
Signed: _____	☐ N/A ☐ Enclosed or Alt. Location: _____
Printed Name: _____	5 Equipment technical data sheets.
Date: ____/____/____	☐ N/A ☐ Enclosed or Alt. Location: _____
Organization: _____	6 Manufacturers published instructions, including operation and maintenance instruction.
Title: _____	☐ N/A ☐ Enclosed or Alt. Location: _____
Phone: _____	7 Battery calculations (where batteries are provided).
16.5 Authority Having Jurisdiction:	☐ N/A ☐ Enclosed or Alt. Location: _____
I have witnessed a satisfactory acceptance test of this with system and find it to be installed and operating properly in accordance with its approved plans and specifications, its approved sequence of operations, and with all NFPA standards cited herein.	8 Voltage drop calculations for notification appliance circuits.
Signed: _____	☐ N/A ☐ Enclosed or Alt. Location: _____
Printed Name: _____	9 Completed record of inspection and testing in accordance with 7.6.6 and 7.8.2.
Date: ____/____/____	☐ N/A ☐ Enclosed or Alt. Location: _____
Organization: _____	10 Completed record of completion in accordance with 7.5.6 and 7.8.2.
Title: _____	☐ N/A ☐ Enclosed or Alt. Location: _____
Phone: _____	11 Copy of site specific software, where applicable.
Equipment Information: _____	☐ N/A ☐ Enclosed or Alt. Location: _____
ID No. 1: _____	12 Record (as-built) drawings.
Serial: _____	☐ N/A ☐ Enclosed or Alt. Location: _____
Access Code: _____	13 Periodic inspection, testing, and maintenance documentation in accordance with Section 7.6.
ID No. 2: _____	☐ N/A ☐ Enclosed or Alt. Location: _____
Serial: _____	14 Records, record retention, and record maintenance in accordance with 7.7.
Access Code: _____	☐ N/A ☐ Enclosed or Alt. Location: _____
	Signed: _____ Date: ____/____/____

Figure 2 Legend Sheet



This document is not intended to be used for installation purposes.
We try to keep our product information up-to-date and accurate.
We cannot cover all specific applications or anticipate all requirements.
All specifications are subject to change without notice.

NOTIFIER
12 Clintonville Road
Northford, CT 06472
www.notifier.com

Notifier ® is a registered trademark of Honeywell International Inc. Space Age Electronics, Inc. is a ©copyright. UL® is a registered trademark of Underwriter's Laboratories Inc.

Country of Origin: US



System Record Documents (SRD) Cabinet

Fire System Record Documents

Description

The Notifier System Record Documents (SRD) Cabinet is the perfect solution to comply with the demanding code standards required today. Notifier's primary goal is to manufacture code compliant solutions and this product allows you to do just that. The SRD cabinet is the answer to comply with the NFPA 72 2013, Section 7.7.2.1 requirements which states, "With every new system, a documentation cabinet shall be installed at the system control unit or other approved location at the protected premises."

This cabinet is constructed of durable 16 gauge steel with a solid piano hinge and key lock. The cabinet includes a 4GB USB memory flash drive interface. Using a standard USB B connector, the USB flash drive interface allows you to use any standard USB printer cable to upload or download information. This feature allows you to store your records electronically in one secure place, so that the Technician can easily access the software and service the system. (Refer to NFPA, 72 2013, Section 7.5.6.7).

Along with the fire alarm control panel software, you can store your test and inspection documents, service records, manuals & AS built drawings for the system.

The System Records Document (SRD) cabinet inner door has two, key ring hooks to hold system keys. In the inner door, you can add the Legend Sheet to record property, system, service, code and AHJ certification information, as well as required documentation. (See Figure 2).

Features

- Installed with a 4 gigabyte digital flash drive interface with USB B connector.
- Offers two, key ring hooks to hold the system keys.
- Contains a frame plate to insert Authorized Personnel business cards.
- Includes a Legend Sheet to record passwords and system information.
- Constructed with 16 gauge steel box and cover for added security with a solid stainless steel piano hinge.
- Coated with a durable baked-on enamel finish (other colors available).
- Built with a stainless steel piano hinge with standard ¾" CAT 30 keyed door lock (other lock assemblies available).

Specifications

SRD System Record Documents Cabinet Dimensions: 12" W x 13" H x 2 1/4" D (30.48 W x 33.02 H x 5.71 D cm).

Door Keylock: Barrel lock and piano hinge. ¾" barrel lock and 12" (30.48 cm) piano hinge.

FAD Cabinet: UL® Listed, constructed of 18 gauge cold rolled steel.

Cabinet Finish: Red powder coat epoxy finish.

Cabinet Cover Label: Silkscreen imprinted with white indelible ink, 1" high lettering labeled, "SYSTEM RECORD DOCUMENTS."

Cabinet Keylock: Keylocked with ¾" barrel lock and 12" (30.48 cm) width stainless steel piano hinge.

Cabinet Backbox: The backbox includes a 4-hole knockout mounting pattern.



Cabinet Frame Plate: Insert frame plate accommodates and protects standard 8 1/2 x 11 manuals and document records.

Cabinet Inner Door Label: Legend Sheet attached to the inner door frame to record property, system, service, code and AHJ certification information, as well as system documentation.

Cabinet Flash Drive Interface: 4 Gigabyte (minimum) digital flash memory drive with a standard USB B connector (used to upload and download information) is securely assembled to the interior cabinet. The drive is restricted to Authorized personnel with permission to use secure hardware devices to access the records.

Cabinet Key Holder: Two key ring holders and a frame plate to insert Authorized Personnel business cards.

Standards

The System Record Documents (SRD) Cabinet is designed to comply with the following standards:

UL Standard: S2580

Agency Listings and Approvals

These listings and approvals apply to the modules specified in this document. In some cases, certain modules or applications may not be listed by certain approval agencies, or listing may be in process. Consult factory for latest listing status.

UL: S2580, Vol. 3

CSFM: 7300-0553:0110

NFPA: 72 2013

NEMA

ISO 9001 Certification

Ordering Information:

NF-SRD: System Record Documents Cabinet, Red. Includes NOTIFIER lock.

Figure 1 shows the interior enclosure of the Fire Alarm Documents cabinet.

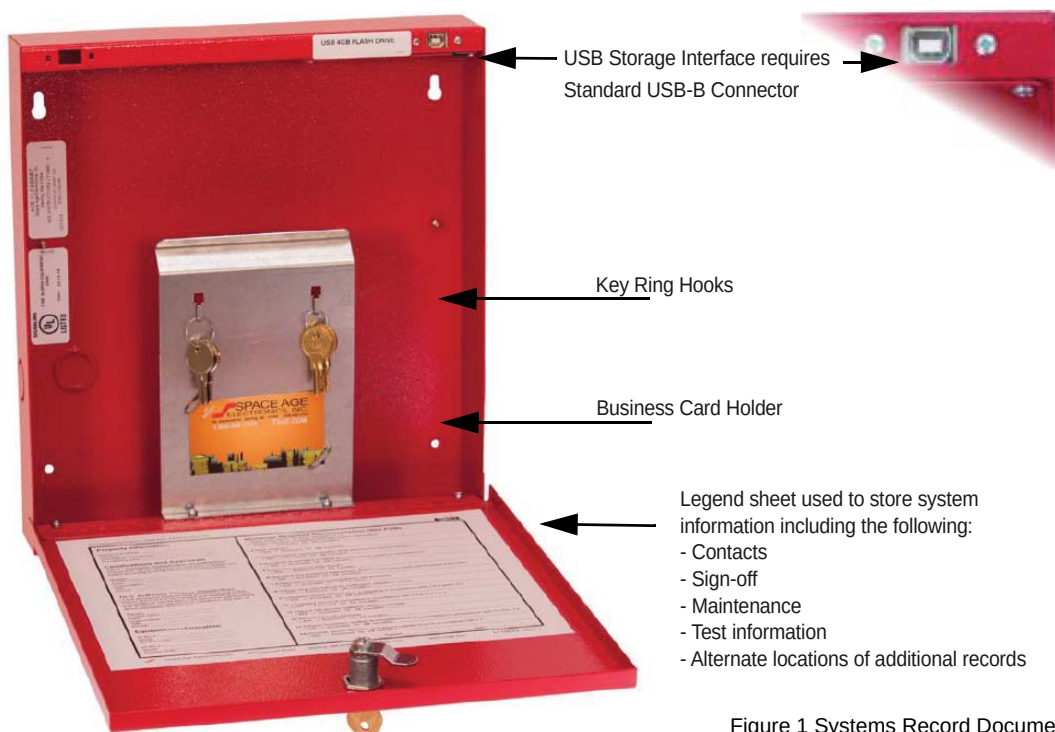


Figure 1 Systems Record Document Cabinet

Figure 2 shows the Legend Sheet attached to the inner door of the Fire Alarm Document Cabinet (See Figure 2).

Property Information	Minimum Required Documentation
Name of Property: _____	1 Written narrative providing intent and system description. ☐ N/A ☐ Enclosed or Alt. Location: _____
Address: _____	2 Riser diagram ☐ N/A ☐ Enclosed or Alt. Location: _____
Description of Property: _____	3 Floor plan layout showing location of all devices and control equipment. ☐ N/A ☐ Enclosed or Alt. Location: _____
Occupancy Type: _____	4 Sequence of operation in either an input/ output matrix or narrative form. ☐ N/A ☐ Enclosed or Alt. Location: _____
Certification and Approvals	5 Equipment technical data sheets. ☐ N/A ☐ Enclosed or Alt. Location: _____
16.1 System Installation Contractor:	6 Manufacturers published instructions, including operation and maintenance instruction. ☐ N/A ☐ Enclosed or Alt. Location: _____
This system, as specified herein, has been installed and tested according to all NFPA Standards cited therein.	7 Battery calculations (where batteries are provided). ☐ N/A ☐ Enclosed or Alt. Location: _____
Signed: _____	8 Voltage drop calculations for notification appliance circuits. ☐ N/A ☐ Enclosed or Alt. Location: _____
Printed Name: _____	9 Completed record of inspection and testing in accordance with 7.6.6 and 7.8.2. ☐ N/A ☐ Enclosed or Alt. Location: _____
Date: ____/____/____	10 Completed record of completion in accordance with 7.5.6 and 7.8.2. ☐ N/A ☐ Enclosed or Alt. Location: _____
Organization: _____	11 Copy of site specific software, where applicable. ☐ N/A ☐ Enclosed or Alt. Location: _____
Title: _____	12 Record (as-built) drawings. ☐ N/A ☐ Enclosed or Alt. Location: _____
Phone: _____	13 Periodic inspection, testing, and maintenance documentation in accordance with Section 7.6. ☐ N/A ☐ Enclosed or Alt. Location: _____
16.5 Authority Having Jurisdiction:	14 Records, record retention, and record maintenance in accordance with 7.7. ☐ N/A ☐ Enclosed or Alt. Location: _____
I have witnessed a satisfactory acceptance test of this with system and find it to be installed and operating properly in accordance with its approved plans and specifications, its approved sequence of operations, and with all NFPA standards cited herein.	
Signed: _____	
Printed Name: _____	
Date: ____/____/____	
Organization: _____	
Title: _____	
Phone: _____	
Equipment Information: _____	
ID No. 1: _____	
Serial: _____	
Access Code: _____	
ID No. 2: _____	
Serial: _____	
Access Code: _____	
	Signed: _____ Date: ____/____/____



This document is not intended to be used for installation purposes.
We try to keep our product information up-to-date and accurate.
We cannot cover all specific applications or anticipate all requirements.
All specifications are subject to change without notice.

NOTIFIER
12 Clintonville Road
Northford, CT 06472
www.notifier.com

Notifier ® is a registered trademark of Honeywell International Inc. Space Age Electronics, Inc. is a ©copyright. UL® is a registered trademark of Underwriter's Laboratories Inc.

Country of Origin: US

