

Safety Bulletin

Issued: 10/2/14

Summary of issue: CO response, i4 Series combination CO/Smoke detector

Level of urgency: **High – Immediate Action Required**

Model Numbers: COSMO-2W, COSMO-4W

Manufactured date range: **September 3 2014 (4091) to September 13, 2014 (4092)**

4091 defined as 4 = 2014, 09 = September, 1 = 1st week of the month

4092 defined as 4 = 2014, 09 = September, 2 = 2nd week of the month

You are receiving this bulletin because you have purchased the i4 series combination CO/Smoke detector manufactured by System Sensor with manufacturing date codes 4091 and 4092.

i4 series combination CO/Smoke detectors manufactured within this time period have the potential for delayed or no response to elevated CO levels. System Sensor has taken the appropriate steps to prevent recurrence and units manufactured outside of 4091 and 4092 are not affected.

All COSMO-2W and COSMO-4W products with date codes 4091 and 4092 need to be returned to the point of purchase for replacement or credit. Please contact your point of purchase to coordinate the product return.

Our goal is to resolve this issue as efficiently as possible and we apologize for the inconvenience. This recall is being conducted in cooperation with the U.S. Consumer Product Safety Commission.


Carton label




Product label



SYSTEM SENSOR
MODEL NO. COSMO-2W
 SIGNALING S911
 **FIRE ALARM SUBASSEMBLY LISTED**
 SMOKE DETECTOR ALSO SUITABLE AS GAS DETECTOR HEAD FOR OPEN AREA PROTECTION.
 ISSUE NO. A-87,935
 PHOTOELECTRIC DETECTION PRINCIPLE AND 85dB SOUNDER
 FACTORY SENS. 0.92-3.79%/FT
 CARBON MONOXIDE DETECTION
 INSTALL/OPERATING TEMP. RANGE: 0-50°C (32-122°F)
 N04-4576-001

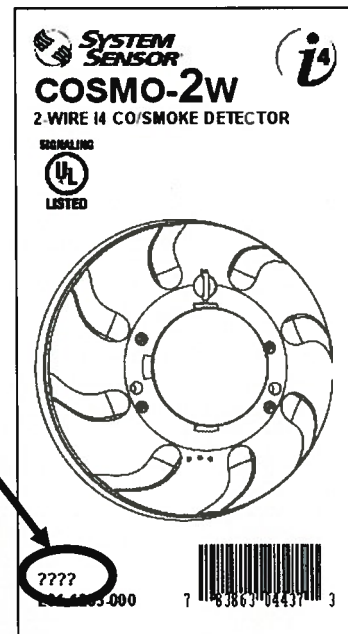WARNING:
 CARBON MONOXIDE IS AN ODORLESS, COLORLESS, TASTELESS GAS. WHEN UNIT IS IN ALARM MOVE TO FRESH AIR IMMEDIATELY.
 DATE OF MFG: 01/17/2013
 REPLACE BY: 01/17/2019
 SEE I56-3747 FOR INSTALLATION, MAINTENANCE AND DETECTOR RATINGS.
 STANDBY CURRENT: 50µA
 ALARM CURRENT: 50mA
 VOLTAGE RANGE: 8.5-35VDC
 PAT: WWW.FIREPAT.NET
 FOR REPAIR SEND TO:
 SYSTEM SENSOR
 3825 OHIO AVE.
 ST. CHARLES, IL
 60174 U.S.A.
 WWW.SYSTEMSENSOR.COM
 MADE IN MEXICO

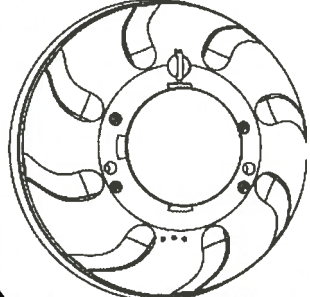

SYSTEM SENSOR 
COSMO-2W
 2 WIRE I4 CO/SMOKE DETECTOR
 SIGNALING
 **LISTED**

 4 digit date code location
 COSMO-2W and COSMO-4W
 ????
 2014 09 01 000 7 63863 04431 3