GENT
by Honeywell


Technical Bulletin	TB 10108

To: Gent by Honeywell, System Integrators & SMS	Date: 23/1/07
	Status: Active
	Type: SI / SMS

Product – Part affected:
Commissioning tool 1.21, Coincidence detection

Details:
When using coincidence detection through the comm. tool. There is now an option to do coincidence via groups, on EN54 systems. This is a tick box in zone configuration. This option works backwards when you think you have groups selected you upload the data to zones.

Action:
This option should not be used. Leave screen in default settings. As default the page is set up correctly even though it says Groups (EN54) it will upload the data to zones.

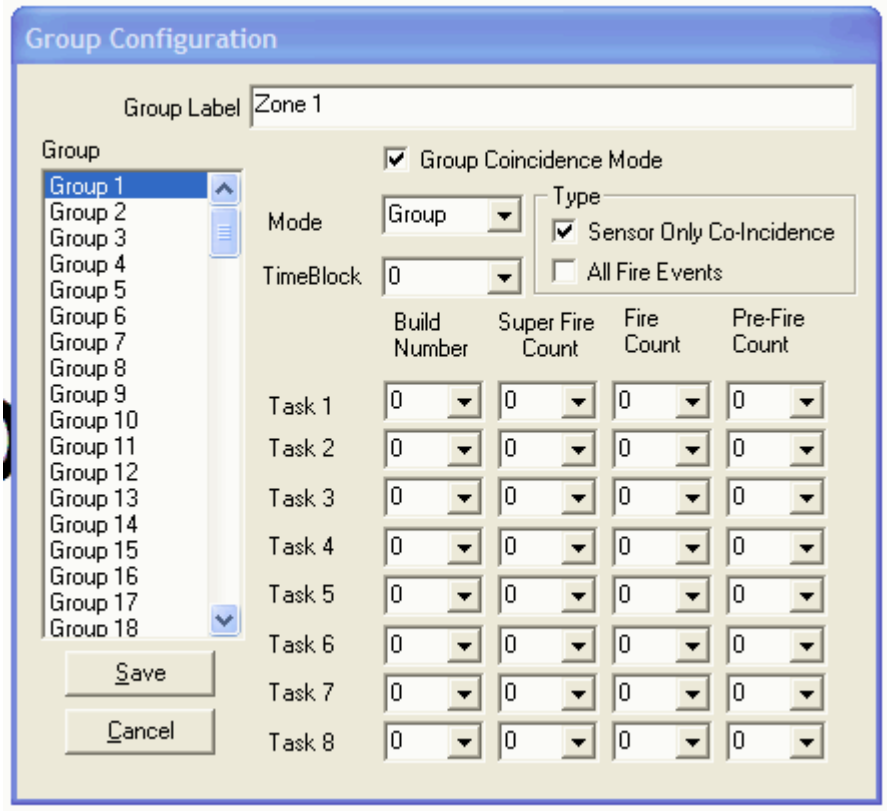

Attached is screen shot of default setting this will upload data to Zones, Not groups as indicated?

On BS panels the option is also backwards so as default in the groups / zones page Zones will be shown but this will still be uploaded correctly to groups.

As long as you remember this option works backwards the configuration uploaded works correctly.

Name: Peter Dodge