



GUIDE TO HAZARDOUS LOCATION APPROVALS

MICRO SWITCH Hazardous Area Limit Switches

There are many considerations when selecting a switch to be used in hazardous areas. In addition to switch performance, it's important to understand the country of use, as well as the approvals each switch carries.

This selection guide will help to define Hazardous Area Approvals and Markings for both North American and Global applications, as well as define the approvals MICRO SWITCH Hazardous Area Switches carry.

For assistance with selecting a hazardous area switch, please contact Honeywell's product team at +1 302 613 4491 (USA/Canada), +81 (0) 3-6730-7152 (Asia-Pacific), +44 1344 238258 (Europe), info.sc@honeywell.com, or your Honeywell distributor.

Honeywell

NORTH AMERICAN TYPICAL MARKING

NORTH AMERICAN TRADITIONAL MARKING

Hazard Class		Area Classification ¹		Gas/Dust Group	
Class I		Division 1		Groups A, B, C, D	
Class I (NEMA Type 7)	Flammable Gas, Vapors, & Mist	Division 1	The hazardous gas/dust is continuously present or intermittently present during normal operation	Group A	Acetylene
				Group B	Hydrogen
				Group C	Ethylene
				Group D	Propane and Methane
Class II (NEMA Type 9)	Combustible Dust	Division 2	The hazardous gas/dust is only present under abnormal conditions	Group E	Combustible metal dusts
				Group F	Combustible carbonaceous dusts
				Group G	Other combustibles (flour, grain, wood, plastic, chemicals)

¹ If a product is covered for Division 2, it will be marked. If the Division is not included in the marking, then it is presumed to be Division 1. Division 1 certified products can be used in Division 1 or 2 areas.

NORTH AMERICAN ZONE STYLE MARKING

Hazard Class		Area Classification		American National Standard		Explosion Protected	
Class I		Zone 0		A		Ex	
Class I	Flammable Gas, Vapors & Mist	Zone 0	Hazardous gas is continuously present	A	Approved to US Standard ISA 60079-*. Differentiates between this Certification and the ATEX and IEC Ex Certifications with use the EN and IEC 60079-* Standards	Ex	Device is explosion protected for use in hazardous environments
		Zone 1	Hazardous gas intermittently present during normal operations				
		Zone 2	Hazardous gas present under only abnormal conditions				
Class II	Combustible Dust	Zone 20	Hazardous dust is continuously present				
		Zone 21	Hazardous dust intermittently present during normal operations				
		Zone 22	Hazardous dust present under only abnormal conditions				

² Typically, IIC is the preferred coverage and will allow the product to be used in IIB and IIA environments as well.


³ Typically, T6 is the preferred coverage and will allow the product to be used in T5-T1 requests (dependent upon the ambient temperature of the application). Most Honeywell limit switches are T6 rated.

COMPARISON ON THE TWO AREA CLASSIFICATION STYLES

Hazard Level	Division Scheme	Zone Scheme
Continuous Hazard	Division 1	Zone 0/Zone 20
Intermittent Hazard		Zone 1/Zone 21
Hazard Under Abnormal Conditions	Division 2	Zone 2/Zone 22

NORTH AMERICAN TYPICAL MARKING

NORTH AMERICAN PRODUCT LABEL EXAMPLE

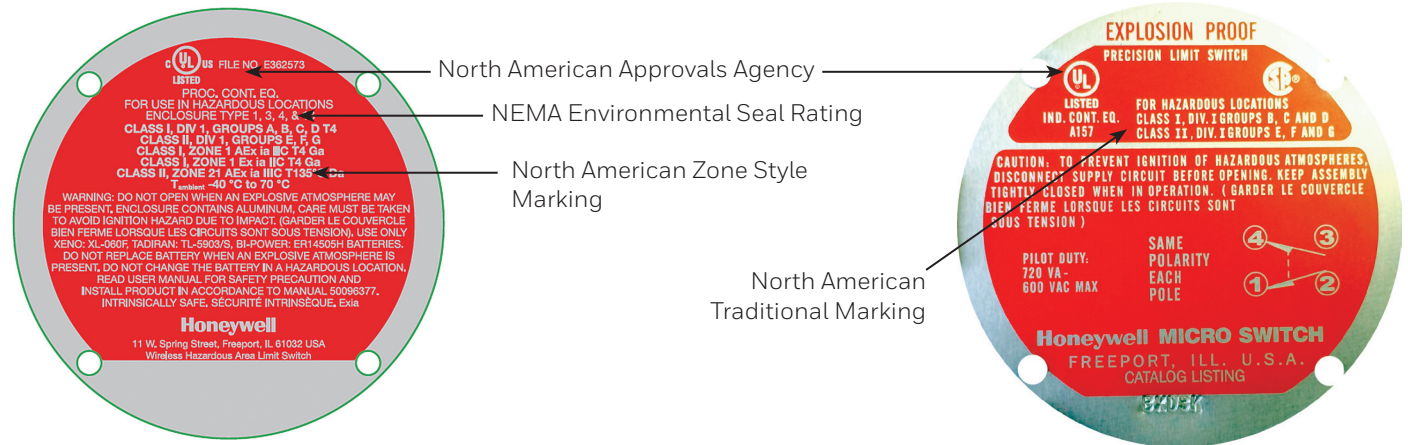


Protection Concept		Gas/Dust Group		Temperature Class		Equipment Protection Level	
da		IIC		T6		Ga	
Protection method the product uses to be used in the hazardous environment		IIC²	Acetylene and Hydrogen	T6³	Maximum surface temperature of 85 °C	Ga	Gas, suitable for Zones 0, 1, 2
da, db, dc	Flame proof. Can contain the explosion and extinguish the flame	IIB + H2	Ethylene and Hydrogen	T5	Maximum surface temperature of 100 °C	Gb	Gas, suitable for Zones 1, 2
		IIB	Ethylene	T4	Maximum surface temperature of 135 °C	Gc	Gas, suitable for Zone 2
		IIA	Propane and Methane	T3	Maximum surface temperature of 200 °C	Da	Dust, suitable for Zones 20, 21, 22
ia, ib, ic	Intrinsically Safe. Limits energy of sparks and surface temperature	IIIC	Combustible metal dusts	T2	Maximum surface temperature of 300 °C	Db	Dust, suitable for Zones 21, 22
		IIIB	Combustible carbonaceous dusts and other combustibles (flour, grain, wood, plastic, chemicals)	T1	Maximum surface temperature of 400 °C	Dc	Dust, suitable for Zone 22

COMPARISON ON THE TWO GAS/DUST GROUP STYLES

Substance	Hazard Class	Division Groups	Zone Groups
Acetylene	Class I	Group A	IIC
Hydrogen		Group B	IIC
Ethylene		Group C	IIB
Propane		Group D	IIA
Methane		Group D	IIA
Combustible metal dusts	Class II	Group E	IIIC
Combustible carbonaceous dusts		Group F	IIIB
Other combustibles (flour, grain, wood, plastic, chemicals)		Group G	IIIB

ATEX AND IEC EX TYPICAL MARKING

ATEX AND IEC EX TYPICAL MARKING • PART 1

Complies with United Kingdom Directive	Complies with European Directive	Notified Body Number	Specific marking for ATEX Directive	Equipment Group		Equipment Category		Environment	
UK CA	CE	Assigned by manufacturing location		II		2		GD	
All products that comply with any United Kingdom Directive are marked with UKCA. This can be the Explosive Atmospheres Directive (ATEX) or any number of other Directives	All products that comply with any European Directive are marked with CE. This can be the Explosive Atmospheres Directive (ATEX) or any number of other Directives	Each notified body (agency) has a number. Honeywell places the number of the notified body that certifies the factory on the label. 1180 will be on all ATEX products from Newhouse, Scotland. 0598 will be on all ATEX products from Juarez, Mexico. 2813 will be on all ATEX products from Nanjing, China	All products that comply with the ATEX Directive for Explosive Atmospheres will be labeled with this symbol	I	Mines	1	Products can be used in Zones 0, 1, 2 and 20, 21, 22	G	Gas environments
				II	All other areas ⁴	2	Products can be used in Zones 1, 2 and 21, 22	D	Dust environments
						3	Products can be used in Zones 2 and 22		

⁴ Honeywell products will all be Equipment Group II. None of our products are certified to be used in mining applications.

ATEX AND IEC EX TYPICAL MARKING • PART 2


Explosion Protected	Protection Concept		Gas/Dust Group		Temperature Class		Equipment Protection Level (EPL)	
Ex	da		IIC or IIIC		T6 or T85°C		Ga	
The device is explosion protected for use in hazardous environments	The protection method the product uses to be able to be used in the hazardous environment		IIC ²	Acetylene and Hydrogen	T6 ³	Maximum surface temperature of 85 °C	Ga	Gas, suitable for Zones 0, 1, 2
			IIB + H2	Ethylene and Hydrogen	T5	Maximum surface temperature of 100 °C	Gb	Gas, suitable for Zones 1, 2
	da, db, dc	Flame proof. Contains the explosion and extinguish the flame	IIB	Ethylene	T4	Maximum surface temperature of 135 °C	Gc	Gas, suitable for Zone 2
			IIA	Propane and Methane	T3	Maximum surface temperature of 200 °C	Da	Dust, suitable for Zones 20, 21, 22
	ia, ib, ic	Intrinsically safe. Limits energy of sparks and surface temperature	IIIC	Combustible metal dusts	T2	Maximum surface temperature of 300 °C	Db	Dust, suitable for Zones 21, 22
			IIIB	Combustible carbonaceous dusts and other combustibles (flour, grain, wood, plastic, chemicals)	T1	Maximum surface temperature of 400 °C	Dc	Dust, suitable for Zone 22

² Typically, IIC is the preferred coverage and will allow the product to be used in IIB and IIA environments as well.

³ Typically, T6 is the preferred coverage and will allow the product to be used in T5-T1 requests (dependent upon the ambient temperature of the application). Most Honeywell limit switches are T6 rated.

ATEX AND IEC EX TYPICAL MARKING



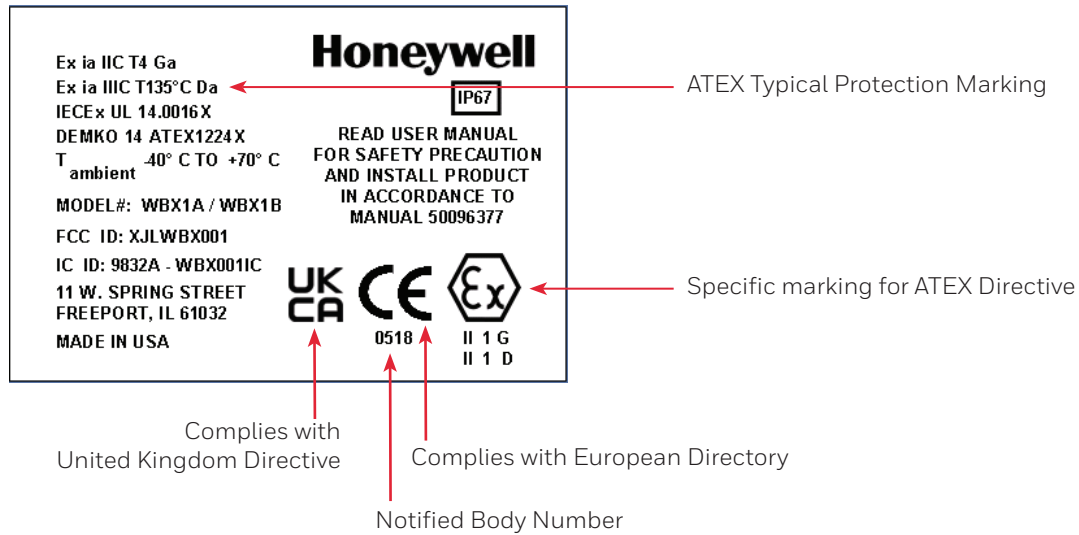


















ATEX AND IEC EX PRODUCT LABEL EXAMPLE



AREA CLASSIFICATION STYLES











Hazard Level	Zone Scheme
Continuous Hazard	Zone 0/Zone 20
Intermittent Hazard	Zone 1/Zone 21
Hazard Under Abnormal Conditions	Zone 2/Zone 22

MICRO SWITCH HAZARDOUS AREA SWITCH APPROVALS

											
	EX	CX	LSX	BX	BX2	GSX	CLSX	GXS	14CE100	V15W2	VPX
	●	●	●	●			●				
	●	●	●	●			●				
				●	●	●					●
	●	●*		●	●	●		●	●		●
	●	●*		●	●	●		●		●	●
	●	●*		●	●	●		●	●		●
	●	●*		●	●	●		●	●		●
		●*		●	●	●					●
				●	●			●			●
		●*		●	●	●					

* Select catalog listings

GLOBAL APPROVAL DESCRIPTIONS

Mark	Country	Approval Description
	North America	UL Mark means UL has tested representative samples of the product and determined the product meets the requirements of UL. These requirements are based primarily on published and nationally recognized Standards for Safety.
	North America	The CSA mark demonstrates that a sample of the product has been certified to applicable standards including standards written or administered by the American National Standards Institute (ANSI), Underwriters Laboratories (UL), CSA Group (CSA), NSF International (NSF), and other North American and global organizations.
	United States and Canada	The cULus mark certifies the equipment was evaluated to Canadian and US standards by Underwriters' Laboratories. The combination mark indicates compliance with both Canadian and U.S. Requirements. "Listed" means that the product can be operated as sold, in accordance with its inscriptions and operating instructions, without retesting by UL. Products are for use in hazardous locations where explosive atmospheres may be present. Certification covers division and zone area classification systems for the United States and/or Canada.
	Europe	The Ex mark is a statement from an independent Notified Body verifying compliance with the requirements of the European standards that are harmonised with the 2014/34/EU Directive (ATEX Directive, named after the French "ATmosphere EXplosible").
	Global	The IEC Ex mark means the equipment complies with the requirements of the International Electrotechnical Commission Explosive. The objective of the IECEx system is to facilitate international trade in equipment and services for use in explosive atmospheres, while maintaining the required level of safety.
	Europe	Notified Body. For equipment used in the European Union in accordance with the ATEX Directive, the CE Mark and the notified body (NB) identification number is used when the NB is involved in the conformity assessment procedure.
	United Kingdom	UKCA marking (UK Conformity Assessed marking) is the UK product marking requirement that will be needed for all Ex products being placed on the market in Great Britain (England, Scotland and Wales), substituting the EU requirements for CE Marking (CE marking will continue to be accepted in Northern Ireland).
	Korea	Korea's KOSHA or KTL (Korea Occupational Safety and Health Agency or Korean Testing Laboratory) is a unified safety certification system which demonstrates that industrial equipment and machinery are safe and consistent quality in manufacturing processes is ensured.
	China	NEPSI is an international testing laboratory accredited by IECEx Scheme, Shanghai Inspection and Testing Center of Electrical Equipment for use in Explosive Atmospheres for National Work Safety authorized by China State Administration of Work Safety (with qualification of Class A). NEPSI runs strictly in accordance with ISO/IEC 17025 and ISO/IEC 17020.
	Brazil	Brazil's IN METRO (Institute of Metrology, Standardisation and Industrial Quality) is the government body responsible for the implementation of measurement, safety and quality standards for electrical and electronic products.

Warranty/Remedy

Honeywell warrants goods of its manufacture as being free of defective materials and faulty workmanship. Honeywell's standard product warranty applies unless agreed to otherwise by Honeywell in writing; please refer to your order acknowledgment or consult your local sales office for specific warranty details. If warranted goods are returned to Honeywell during the period of coverage, Honeywell will repair or replace, at its option, without charge those items that Honeywell, in its sole discretion, finds defective. **The foregoing is buyer's sole remedy and is in lieu of all other warranties, expressed or implied, including those of merchantability and fitness for a particular purpose. In no event shall Honeywell be liable for consequential, special, or indirect damages.**

While Honeywell may provide information or engineering support for its products through Honeywell personnel, literature and website, it is the buyer's sole responsibility to determine the suitability of the Honeywell product(s) for the buyer's requirements.

Specifications may change without notice. The information we supply is believed to be accurate and reliable as of this writing. However, Honeywell assumes no responsibility for its use.

For more information

Honeywell Sensing Solutions services its customers through a worldwide network of sales offices and distributors. For application assistance, current specifications, pricing or the nearest Authorized Distributor, visit sps.honeywell.com/ast or call:

USA/Canada	+302 613 4491
Latin America	+1 305 805 8188
Europe	+44 1344 238258
Japan	+81 (0) 3-6730-7152
Singapore	+65 6355 2828
Greater China	+86 4006396841

Honeywell Sensing Solutions

830 East Arapaho Road
Richardson, TX 75081
www.honeywell.com

002399-11-EN | 11 | 06/24
© 2024 Honeywell International Inc.

Honeywell